



***Facility Study for Generation
Interconnection Request
GEN-2006-048***

***SPP Tariff Studies
(#GEN-2006-048)***

April 2009

Summary

Pursuant to the tariff and at the request of the Southwest Power Pool (SPP), Xcel Energy Inc., performed the following Facility Study to satisfy the Facility Study Agreement executed by the requesting customer and SPP for SPP Generation Interconnection request GEN-2006-048. The request for interconnection was placed with SPP in accordance SPP's Open Access Transmission Tariff, which covers new generation interconnections on SPP's transmission system.



**Facilities Study For
Southwest Power Pool (SPP)**
150 MW Wind-Generated Energy Facility
Eddy Co., New Mexico
SPP #GEN-2006-048

July 15, 2008

Xcel Energy Services, Inc.
Transmission Planning

Executive Summary

[omitted text] in January 2008 (“Interconnection Customer”) requested the interconnection of a wind energy facility located in Eddy County, New Mexico to the Southwestern Public Service Company (SPS), a New Mexico Corporation and wholly owned subsidiary of Xcel Energy Inc., 115 kV transmission network. This facility has a net capacity of 150 MW. The Interconnection Customer’s facility will connect to the existing SPS Seven-Rivers Interchange located approximately sixteen (16) miles northwest of Carlsbad, New Mexico.

The Southwest Power Pool (SPP) evaluated the request to interconnect the wind farm facility to the SPS transmission system in a System Impact Study (SIS) (GEN-2006-048) completed in December 4, 2007. The interconnection request was studied using one hundred (100) units of Acciona Wind Turbines Model AW1500 at 1.5 MW each for a total output of 150 MW. The study’s minimum requirement will consist of adding a 115 kV line terminal at SPS Seven-Rivers Interchange as interconnection point. The Interconnection Customer is required to build twenty-two (22) miles of 115 kV transmission lines from their substation wind farm facility to the SPS Seven-Rivers Interchange 115 kV bus. The customer is also required to build a 40 MVAR capacitor bank on the 34.5 kV side of their collector’s 115/34.5 kV bus to maintain zero reactive flow at the interconnection point. The Interconnection Customer’s expected commercial operation date is December 31, 2010 and the requested back-feed date is September 1, 2010.

SPS requires that all construction for this request be in compliance with the latest revision of the Xcel Energy Interconnection Guidelines for Transmission Interconnection Producer-Owned Generation Greater than 20 MW, Version 3.0 dated Dec 31, 2006, and is available at (http://www.xcelenergy.com/XLWEB/CDA/0.3080.1-1-1_16699_24407-1428-0_0_0-0.00.html). This document describes the requirements for connecting new generation to the Xcel Energy transmission systems including technical, protection, commissioning, operation, and maintenance. SPS will also require that the Interconnection Customer be in compliance with all applicable criteria, guidelines, standards, requirements, regulations, and procedures issued by the North American Electric Reliability Corporation (NERC), Southwest Power Pool (SPP), and the Federal Energy Regulatory Commission (FERC) or their successor organizations.

The Interconnection Customer is responsible for the cost of the Interconnection Facilities, installation of the 40 MVAR cap banks and any Direct Assigned Interconnection Facilities; inclusive of all construction required for the 115 kV transmission line from the Interconnection Customer’s substation to the SPS Seven-Rivers Interchange.

As for this request (GEN-2006-048), it is anticipated that the entire process of adding the new 115 kV line terminal at Seven-Rivers Interchange for the acceptance of the wind farm facility output, will require approximately 12 months to complete after an Interconnection Agreement is signed and an authorization to proceed is received.

The cost of these upgrades, inclusive of the Interconnection Customer’s cost for the interconnection of this wind farm facility, is shown below in Table 1, with the detailed description of the cost shown in Table 3.

Table 1, Cost Summary¹

	Seven-Rivers Interchange
Network Upgrades:	\$74,376
Interconnection Facilities ² :	\$815,084
Total:	\$889,460

¹ The cost estimates are 2008 dollars with an accuracy level of ±10%.

² This is a direct assigned cost to the Interconnection Customer.

General Description of SPS Facilities³


1. **Construction of New Line Terminal:** See Appendix A, Figure A- 1 for general vicinity location map.
 - 1.1. **Location:** SPS will add a new 115 kV line terminal at the existing SPS Seven-Rivers Interchange. Appendix A, Figure A- 2, shows the one-line of the existing substation, while Appendix A, Figure A- 3 shows the preliminary general arrangement plan view.
 - 1.2. **Bus Design:** The new 115 kV line terminal will be added to the existing 115 kV bus at Seven-Rivers Interchange to accommodate the output from the wind energy facility. The existing bus design at Seven-Rivers Interchange is a main bus design and has five (5) existing 115 KV breakers shown in Appendix A, Figure A- 2.
 - 1.3. **Line Terminals:** The 115kV lines and static wire terminals will be designed to accommodate 2,000 pounds per phase conductor at maximum tension, with a maximum 15-degree pull off from normal.
 - 1.4. **Control House:** The existing control house will be extended in order to accommodate the new metering, protective relaying and control devices, terminal cabinets, and any fiber-optic cable terminations, etc. for the new 115kV line breaker terminal.
 - 1.5. **Security Fence:** The existing security fence shall be extended if required when the new bay is added for the new 115 kV line terminal.
 - 1.6. **Ground Grid:** The existing ground grid shall be extended to accommodate the additional bay required for the new line terminal per ANSI/IEEE STD 80-1986, with our standard 4/0 copper ground mesh on 40-foot centers with ground rods and 20-foot centers in corners and loop outside of fence.
 - 1.7. **Site Grading:** Company contractor, per company specifications, will perform any site grading and erosion control to accommodate the new line terminal. Soil compaction shall be not less than 95% of laboratory density as determined by ASTM-D-698.
 - 1.8. **Station Power:** The existing switching station power, provided from the local distribution system, will be utilized.
 - 1.9. **Relay and Protection Scheme:** The new 115 kV breaker line terminal primary protection to the interconnection customer 115 kV transmission line will use line current differential relaying over optical fiber installed in the static of the customer's 115 kV transmission line. Secondary relaying will use mirrored bit, directional comparison blocking over the optical fiber. An SEL 311L and an SEL 321-1 will be used as primary and secondary relays, respectively. An SEL 279H-2 relay will be installed; however no automatic re-closing scheme will be used. The SEL 279H-2 will be used for line/bus SCADA closing conditions for the 115 kV breaker. Also, a SEL 501-0 will be used for breaker failure.

³ All modifications to SPS facilities will be owned, maintained and operated by SPS.

An SEL DTA-2 will display the bus voltage, GCB amps, MW, MVAR, and fault location. An SEL 2020 will be installed for relay communications and other functions as required.

- 1.10. **Revenue Metering:** On the proposed SPS Seven-Rivers Interchange 115 kV line terminal to the Interconnection Customer's substation, an individual billing meter will be installed along with an ION 8400 meter unit, ANSI C12.1 accuracy class 0.2 (3-PT's IEEE C57.13 accuracy class 0.3 and 3 CT's IEEE C57.13 accuracy class 0.15) for full 3 phase 4-wire metering. Also installed for the metering units will be 3-PT's and 3-CT's for full 3-phase 4-wire metering. There will be two meters per line terminal: one will be primary and the other will be back up, each will have full 4 quadrant metering. Pulses out of the primary billing meter will be sent via SCADA to the Transmission Owner's Control Center in Amarillo, Texas.
- 1.11. **Disturbance Monitoring Device:** Disturbance-monitoring equipment (DFR), capable of recording faults, swings, and long term trending, will be installed to monitor and record conditions in the substation and on the transmission lines. The disturbance equipment shall also be equipped with a GPS time synch clock. This equipment will have communication capability with a dedicated communication circuit. The disturbance equipment will have its own dedicated dial-up communications telephone circuit.
- 1.12. **Remote Terminal Unit (RTU):** The existing RTU will be utilized to accommodate the new 115 kV line terminal at Seven-Rivers Interchange. SPS will provide and install if needed additional RTU cards for metering and telemetry as required by the latest Xcel Energy Interconnection Guidelines. The direct cost will be charged to the Interconnection Customer.
- 1.13. **Communications:** Existing telephone and data circuit at Seven-Rivers Interchange to the Amarillo Control Center will be utilized. ***It is the Interconnection Customer's responsibility to make arrangements with the local phone company to provide telephone circuits to the relay communication equipment and disturbance-monitoring equipment at Seven-Rivers Interchange and to their wind farm facility. Prior to any construction the Interconnection Customer is required to contact the SPS substation-engineering department for all details.***

A schematic outlining the proposed communications is provided below:

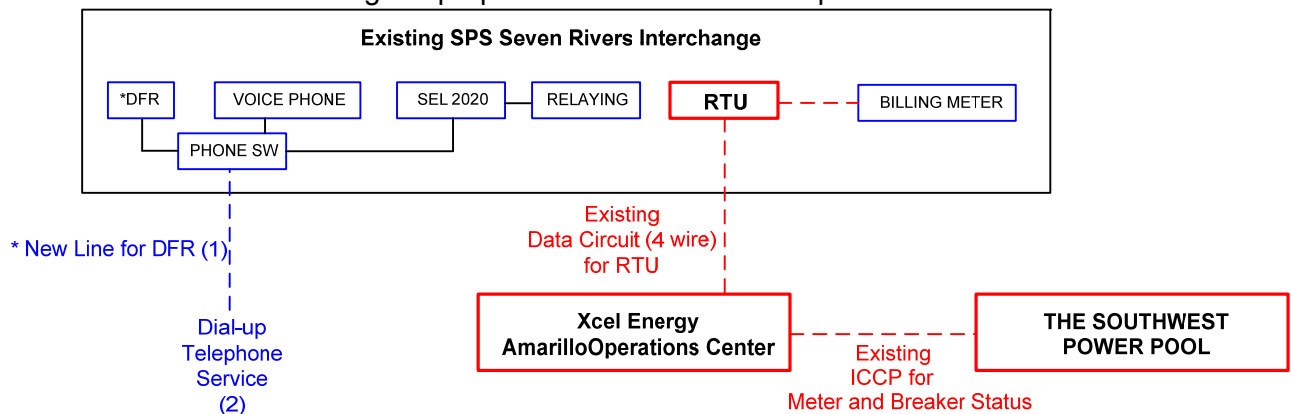

The Interconnection Customer shall be responsible for providing fiber optic communication circuit installed in their overhead transmission line static wire for protective relaying from the customer substation to the existing Seven-Rivers Interchange indicated in Section 1.9.

2. Transmission Work:

- 2.1. The Interconnection Customer will construct, own, operate, and maintain any customer owned 115 kV transmission line from the Interconnection Customer's substation to the Interconnection Point at SPS Seven-Rivers Interchange as shown in Appendix A, Figure A-1. ***The SPS transmission design group prior to any construction by the Interconnection Customer or its contractor on any customer 115 kV transmission lines, or doing work in close proximity to any SPS transmission line, will require an engineering review of the customer's design. It is the Interconnection Customer's responsibility to initiate the design review in a timely manner before construction of any transmission line begins. If the review has not been made or the design at any of the aforementioned locations is deemed inadequate, the crossing(s) and or termination into the SPS Seven-Rivers Interchange will be delayed until the matters are resolved. SPS will not be held responsible for these delays.***

3. Right-Of-Way and Permits:

- 3.1. **Permitting:** Permitting for the construction of a new 115 kV line terminal at Seven-Rivers Interchange is not required from the Public Utility Commission in the State of New Mexico. The interconnection customer will be responsible for any permitting and right of way of their substation and the 115 kV transmission line from their substation to the Interconnection Point at Seven-Rivers Interchange.

4. **Construction Power and Distribution Service:** It is the sole responsibility of the Interconnection Customer to make arrangements for both construction and station power, which may be required for the Interconnection Customer's wind farm facility. **Additionally, if the Interconnection Customer's substation(s) and/or construction site(s) are located outside of the SPS service area, SPS cannot provide station power (retail distribution service) and the Interconnection Customer needs to make arrangements for distribution service from the local retail provider.**

5. Project and Operating Concerns:

- 5.1. Close work between the Transmission group, the Interconnection Customer's personnel and local operating groups will be imperative in order to meet any in-service date that has been established.
- 5.2. It is understood that the 40 MVAR Capacitor Bank will installed at the Interconnection Customer's 34.5 bus side. To avoid voltage spikes on the 115 kV that adversely affect the Xcel Energy transmission system. The Interconnection customer will be required to switch the 40 MVAR capacitor bank in stages of 20 MVAR or less. This is required to maintain acceptable dynamic voltage rise as per latest revision of the Xcel Energy Interconnection Guidelines for Transmission Interconnection Producer-Owned Generation Greater than 20 MW, Version 3.0 dated Dec 31, 2006, and is available at (http://www.xcelenergy.com/XLWEB/CDA/0.3080.1-1-1_16699_24407-1428-0_0_0-0,00.html).

6. **Fault Current Study:** The available fault current at the interconnection location, without any contribution from the wind farm facilities, is shown in Table 2 below.

Table 2, - Available fault current at Point of Interconnection Location

Short Circuit Current Availability at Seven-Rivers Interchange without contribution from Wind Farm Facility (GEN 2006-048)				
Fault Location	Fault Current (Amps)		Impedance (Ω)	
	Line-to-Ground	3-Phase	Z^+	Z^0
69 kV Bus	2525	2275	1.224+j17.525	0.203+j12.071
115 kV Bus	6850	6250	1.630+j10.498	0.811+j7.846
230 kV Bus	3925	4175	4.261+j31.560	5.368+j37.702

Estimated Construction Costs


The projects required for the interconnection of this 150 MW Wind Farm facility consist of the projects summarized in the table below.

Table 3, Required Interconnection Projects

Project	Description	Estimated Cost ⁴
Network Upgrades		
1	Disturbance Monitoring Device	\$74,376
2	Transmission Line Work	\$0
3	Right-Of-Way	\$0
Subtotal:		\$74,376
Transmission Owner Interconnection Facilities (at the Interconnection Customer's expense)		
4	Communications ⁵	\$ See footnote
5	115 kV Breaker Line Terminal	\$ 795,958
6	Remote Terminal Unit (RTU)	\$ 5,313
7	Revenue metering	\$ 8,075
8	115 kV Line arrestors	\$ 5,738
Subtotal:		\$815,084
Total Cost:		\$889,460

Engineering and Construction:

An engineering and construction schedule for the installation of the 115 kV line terminal is depicted below and is estimated at approximately 12 months. The schedule is shown for project duration purposes only and other factors associated with clearances, equipment delays and work schedules could cause additional delays. The schedule below is applicable after all required agreements are signed and internal approvals are granted.

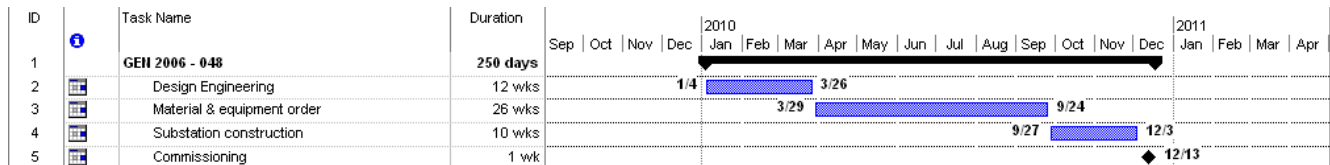

All additional cost for work not identified in this study is the sole responsibility of the Interconnection Customer unless other arrangements are made.

⁴ The cost estimates are 2008 dollars with an accuracy level of $\pm 10\%$.

⁵ It is the Requester's responsibility to provide both the data circuit and both dial-up telephone circuits, see Section 1.13.

Appendix A

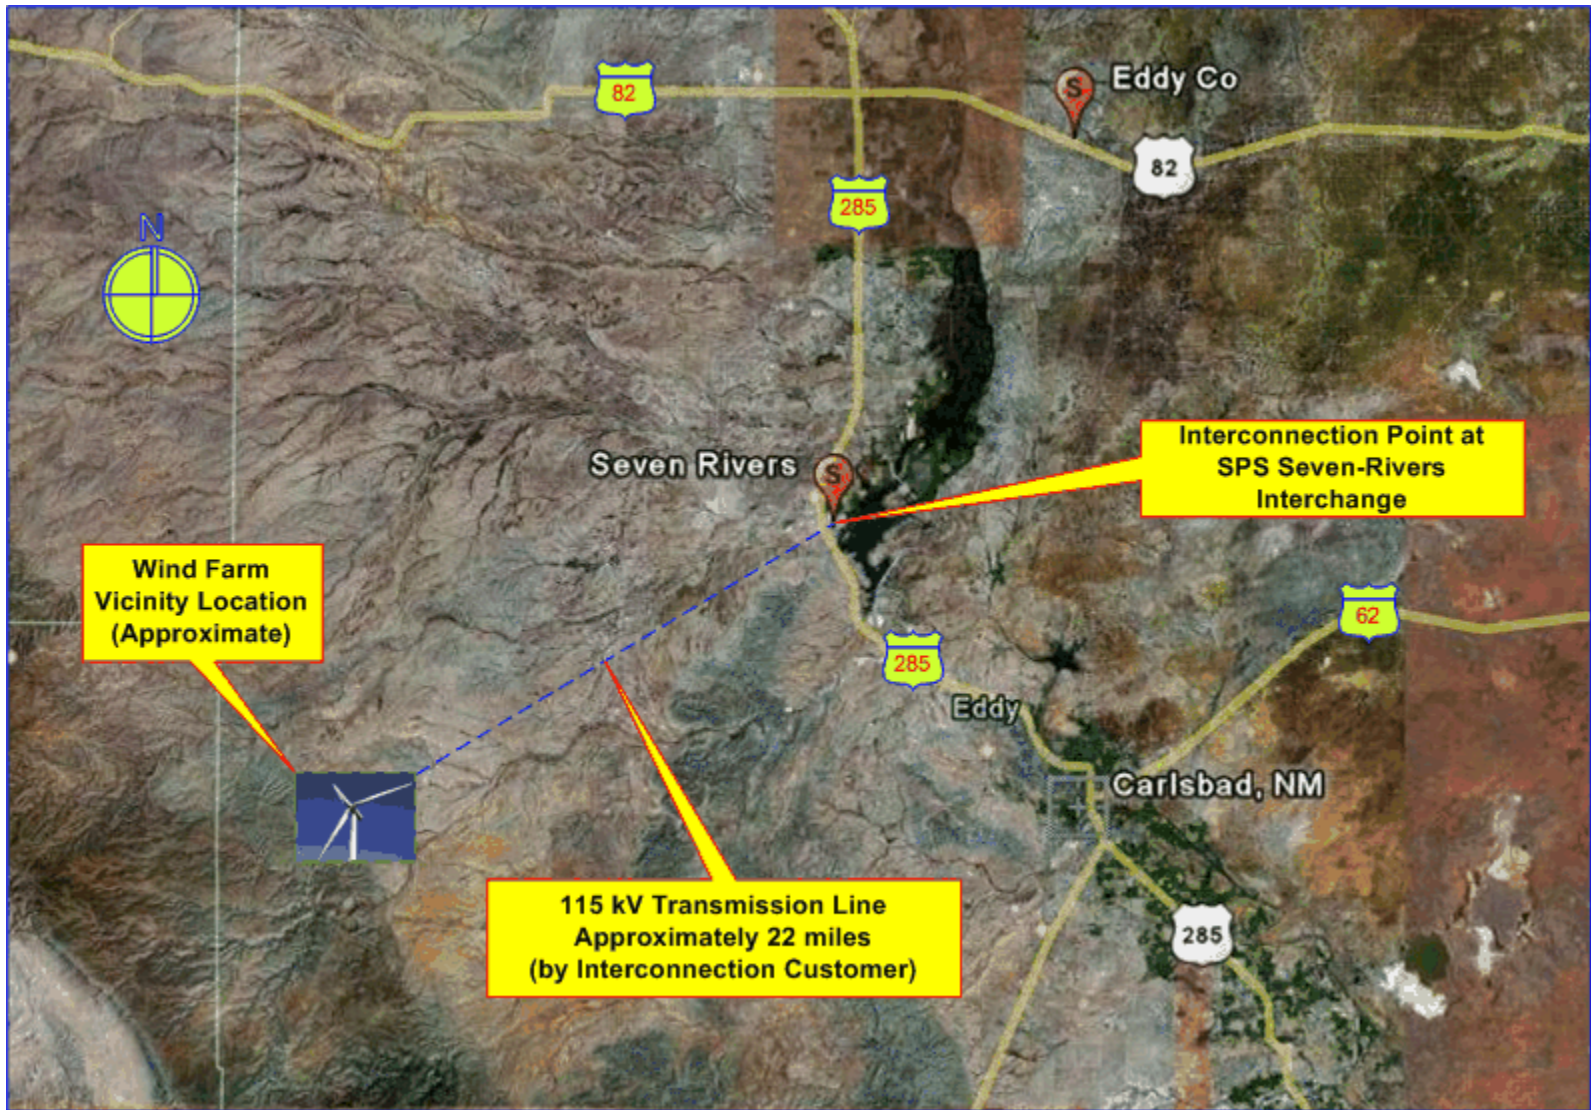


Figure A- 1 Approximate location of proposed Wind Farm Facility and Interconnection Customer 115 KV Transmission Line⁶

⁶ 115 kV customer transmission line shown does not represent actual route.

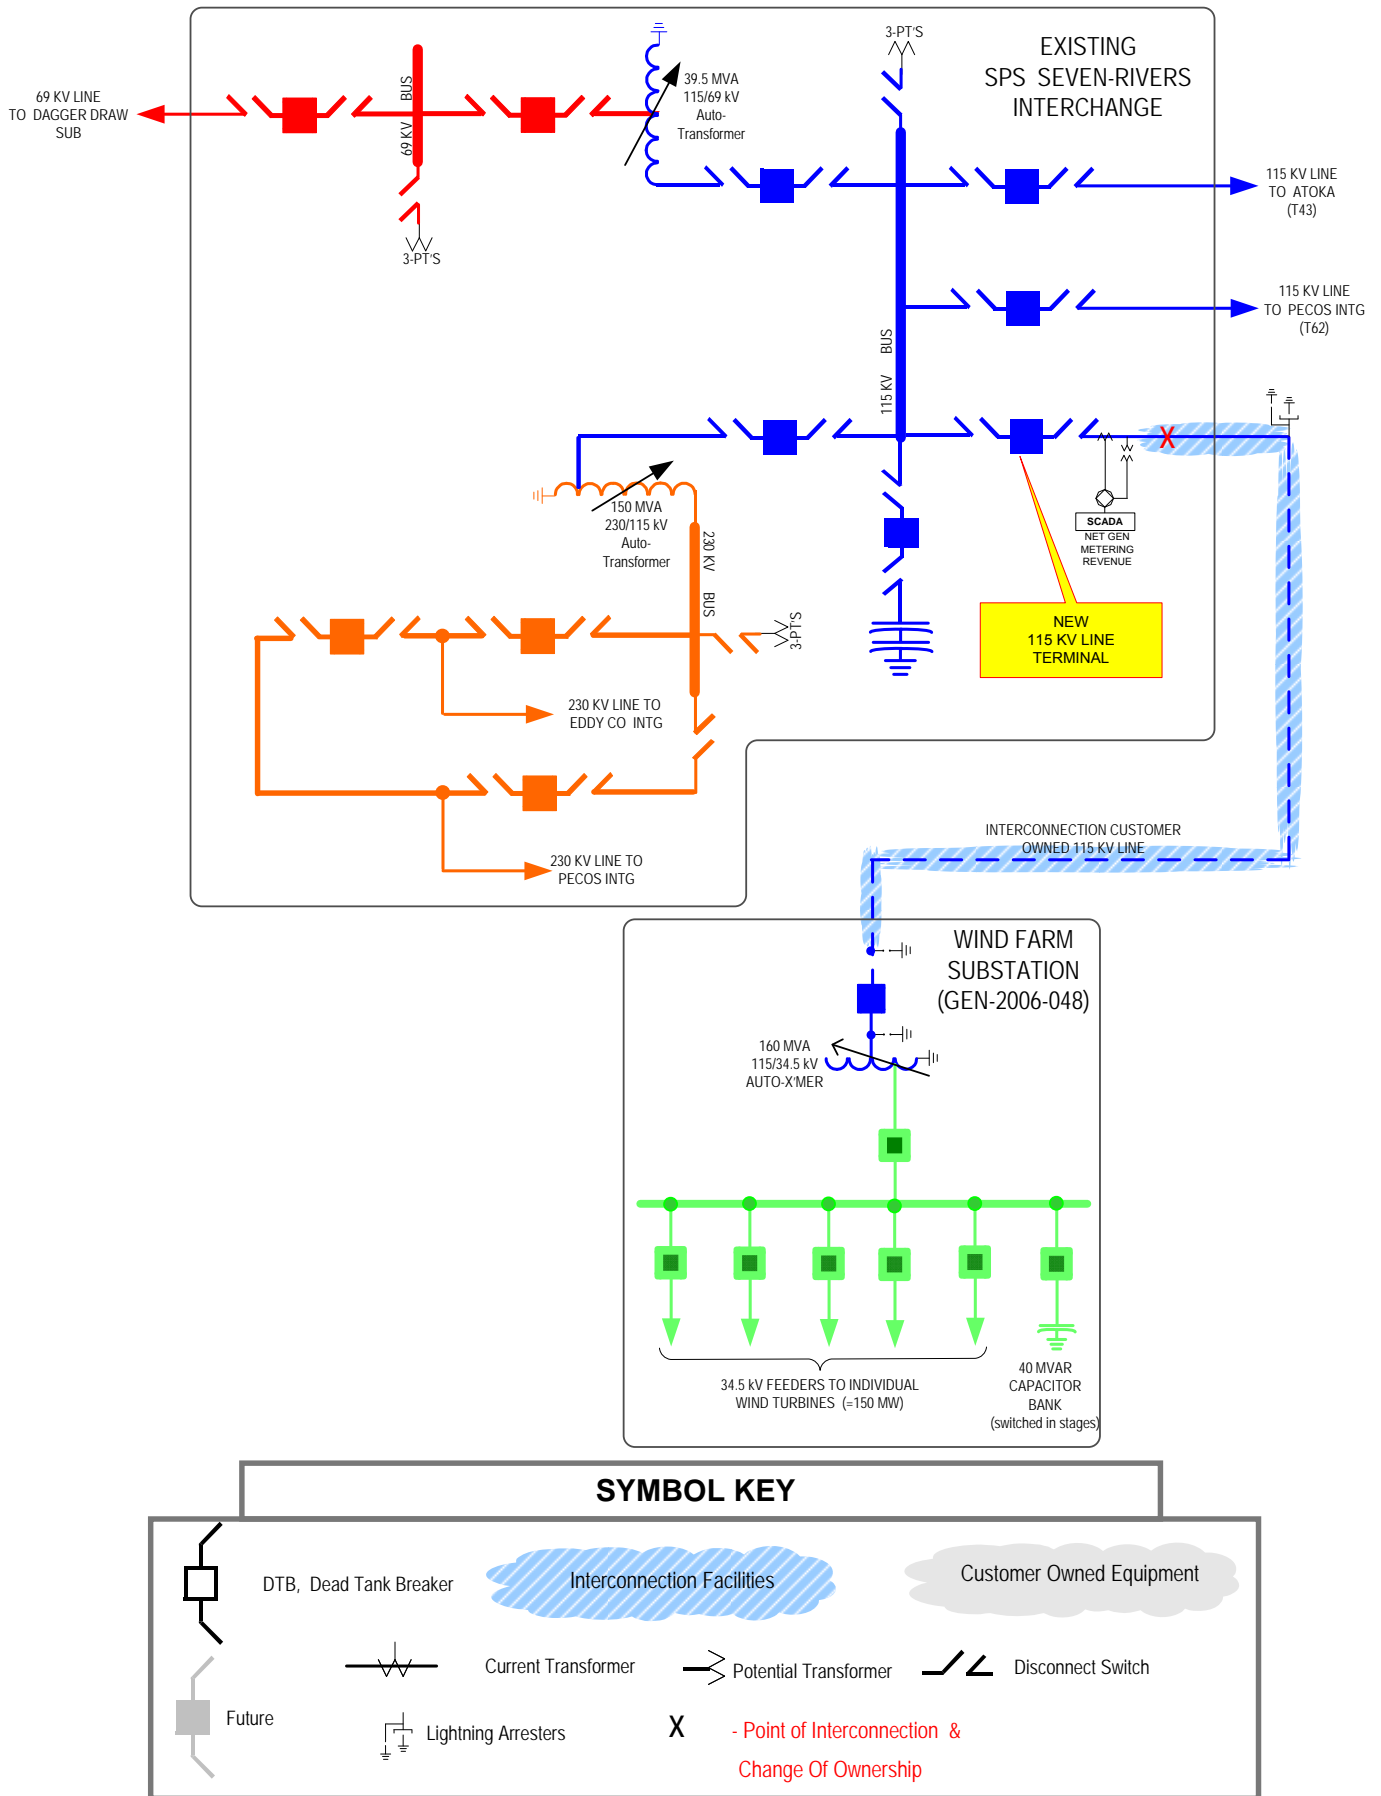


Figure A- 2 One-line Diagram of Seven-Rivers Interchange

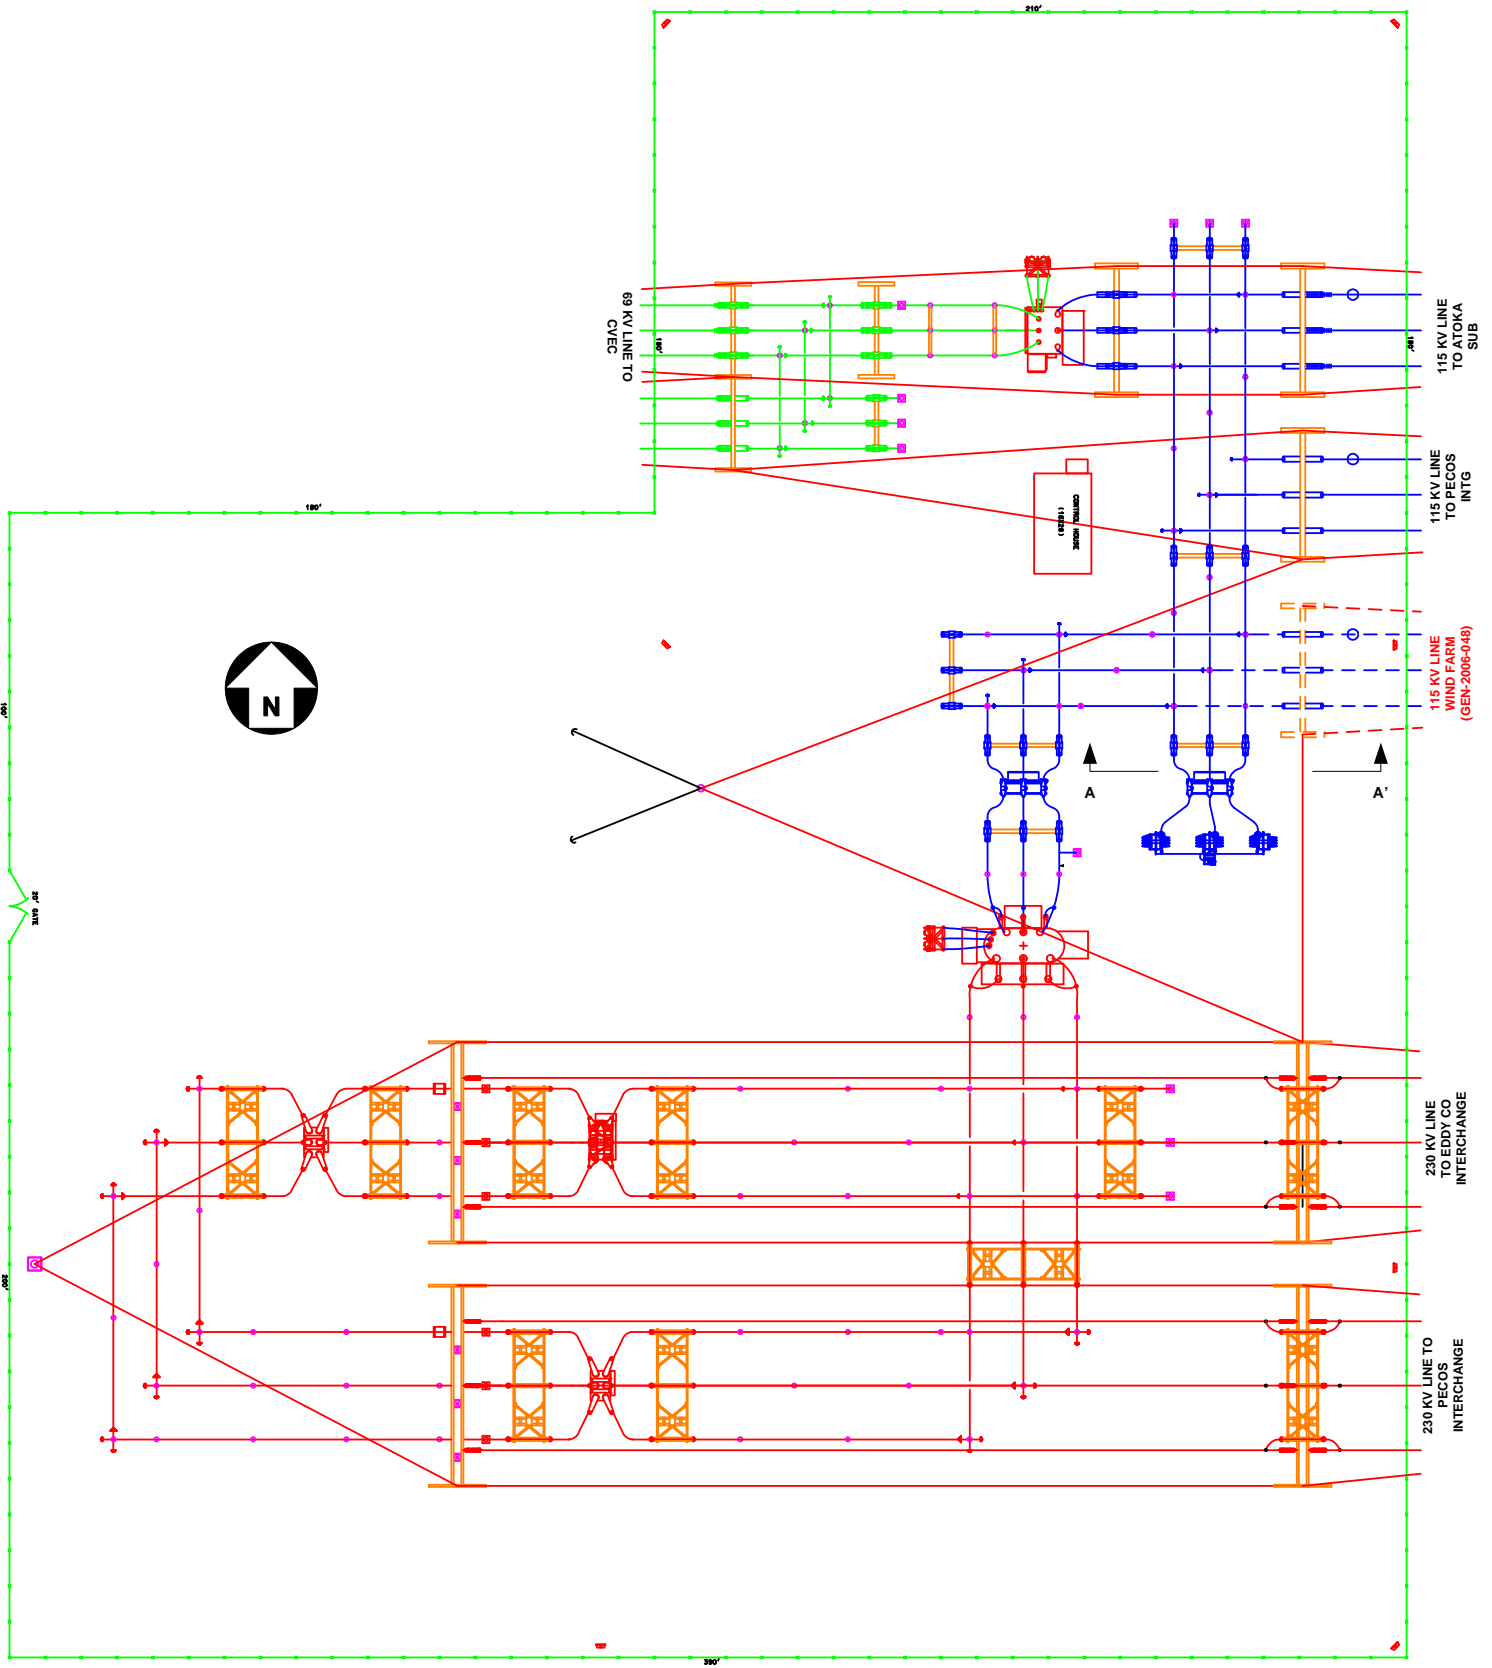


Figure A- 3 SPS Seven-Rivers Interchange Interconnection Facility Plan View

**CUSTOMER SHALL PROVIDE
ALL MATERIAL FOR DEAD
ENDING PHASES AND STATIC
TO 115 kV DEAD END TOWER.**

Customer's Responsibility

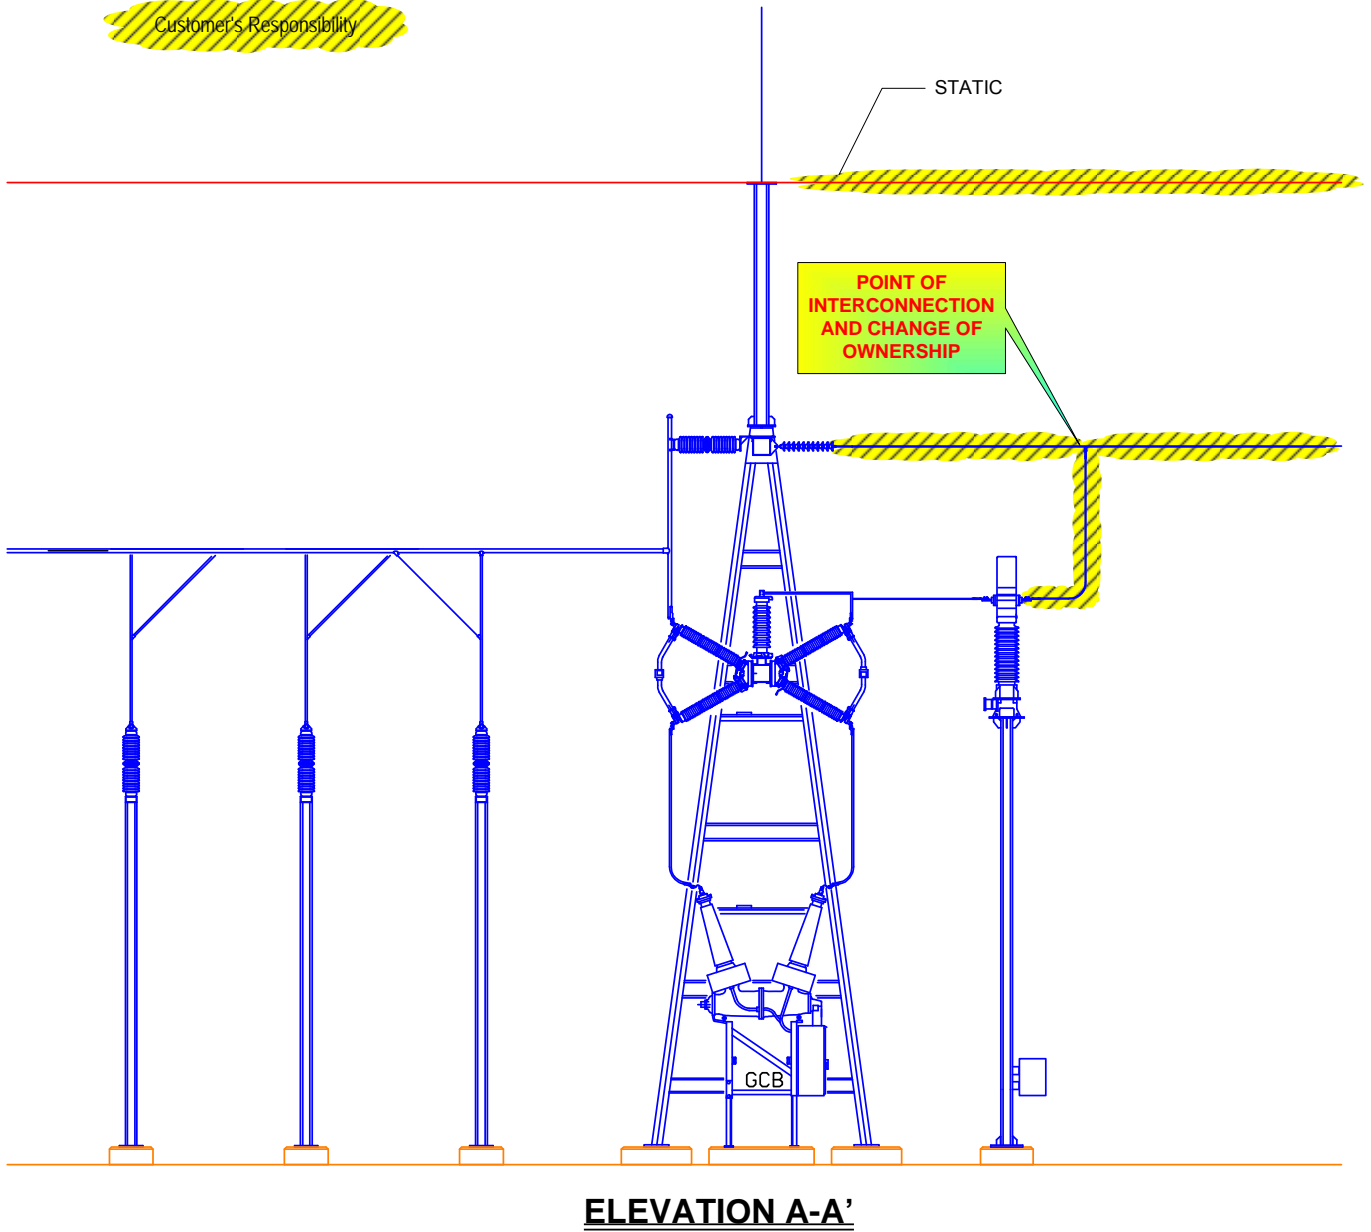


Figure A- 4 Point of Interconnection & Change of Ownership (Typical)

– END OF REPORT –