



**Interconnection Facilities Study
For
Generator Interconnection
Request
GEN-2013-010
(IFS-2014-002-01)**

***SPP Generator
Interconnection Studies***

***(#GEN-2013-010)
(#IFS-2014-002-01)***

October 2015

Revision History

Date	Author	Change Description
9/15/2015	SPP	Draft Interconnection Facilities Study Report Revision 0 Issued
10/19/2015	SPP	Final Interconnection Facilities Study Report Revision 0 Issued

Summary

ITC-Great Plains (ITCGP) performed a detailed Interconnection Facilities Study at the request of Southwest Power Pool (SPP) for Generator Interconnection request GEN-2013-010/IFS-2014-002-01 (99.00 MW/Wind) located in Rush County, Kansas. The Interconnection Customer's originally proposed in-service date for GEN-2013-010/IFS-2014-002-01 is December 31, 2017. SPP has proposed the full interconnection service in-service date will be after the assigned Interconnection Facilities, Non-Shared Network Upgrade(s), and Shared Network Upgrade(s) are completed. Full Interconnection Service will require the Network Upgrades listed in the "Other Network Upgrades" section. The request for interconnection was placed with SPP in accordance with SPP's Open Access Transmission Tariff, which covers new generation interconnections on SPP's transmission system.

Phases of Interconnection Service

It is not expected that interconnection service will require phases however, interconnection service will not be available until all interconnection facilities and network upgrades can be placed in service.

Interconnection Customer Interconnection Facilities

The Interconnection Customer's generation facility consists of thirty-three (33) Siemens 3.0 MW wind turbines for a total generation nameplate capacity of 99.00 MW. The 34.5kV collector system for this wind facility is planned to be connect to one (1) 345/34.5kV Interconnection Customer owned and maintained transformer at the Interconnection Customer owned substation. A short (< 1 mile) overhead 345kV transmission circuit will connect GEN-2013-010/IFS-2014-002-01 to the Point of Interconnection (POI) at a new ITCGP owned 345kV bus at a new ITCGP station that will be located approximately twenty-three (23) miles from Post Rock 345kV on the Spearville – Post Rock 345kV transmission circuit. The Interconnection Customer will be responsible for all of the transmission facilities connecting the Interconnection Customer owned substation to the Point of Interconnection (POI).

The Interconnection Customer will be responsible for any equipment located at the Customer substation necessary to maintain a power factor of 0.95 lagging to 0.95 leading at the POI, including approximately 2.8 Mvar¹ of reactors to compensate for injection of reactive power into the transmission system under reduced generating conditions. Also, the Interconnection Customer will need to coordinate with the Transmission Owner for relay, protection, control, and communication system configurations.

Transmission Owner Interconnection Facilities and Non-Shared Network Upgrades

To allow interconnection the Interconnecting Transmission Owner, ITC-Great Plains (ITCGP), will loop the Spearville and Post Rock terminals into the new station and construct a new three breaker ring bus with three (3) new 345kV breakers and associated terminal equipment for acceptance of the Interconnection Customer's Interconnection Facilities.

¹ This approximate amount of reactors is an approximate minimum amount needed for the configuration of the wind farm studied in DISIS-2014-002 Group 03 Reduced Wind Analysis. This approximate amount of reactors is subject to change based on results of modification study discussed above.

Currently, ITCGP estimates an Engineering and Construction (E&C) lead time of approximately ninety-seven (97) weeks after a fully executed Generation Interconnection Agreement (GIA) for the completion of Transmission Owner Interconnection Facilities and Non-Shared Network Upgrades. At this time, GEN-2013-010/IFS-2014-002-01 is responsible for \$11,021,522 of Transmission Owner Interconnection Facilities and Non-Shared Network Upgrades. **Table 1** displays the estimated costs for Transmission Owner Interconnection Facilities and Non-Shared Network Upgrades.

Table 1: GEN-2013-010/IFS-2014-002-01 TOIF and Non-Shared Network Upgrades

Transmission Owner Interconnection Facilities and Non-Shared Network Upgrades Description	Allocated Cost (\$)	Allocated Percent (%)	Total Cost (\$)
ITCGP Interconnection Substation - Transmission Owner Interconnection Facilities 345kV Substation work for a new line terminal position, disconnect switch, station post insulators, arrestors, dead end structure, and relay panels	\$713,375	100%	\$713,375
ITCGP Interconnection Substation - Network Upgrades 345kV Substation work for building a new three breaker ring bus, 3- 345kV breakers, 8 disconnect switches, communication, revenue metering, line arrestors, breaker control panels, and associated siting.	\$10,308,147	100%	\$10,308,147
Total	\$11,021,522	100%	\$11,021,522

The Interconnection Customer was studied within the DISIS-2014-002 Impact Study and the DISIS-2014-002-1 Impact Restudy as Energy Resource Interconnection Service (ERIS) with updated cost allocations in DISIS-2014-002-2 Impact Restudy. At this time, the Interconnection Customer is allocated \$0 for Non-Shared Network Upgrades identified in the latest impact restudy. Current cost estimate and upgrade descriptions are listed in **Table 2**.

Table 2: GEN-2013-010/IFS-2014-002-01 DISIS-2014-002-2 Non-Shared Network Upgrades

Non-Shared Network Upgrades Description	Allocated Cost (\$)	Allocated Percent (%)	Total Cost (\$)
None			
Total			

Shared Network Upgrades

The Interconnection Customer was studied within the DISIS-2014-002 Impact Study and the DISIS-2014-002-3 Impact Restudy as Energy Resource Interconnection Service (ERIS). At this time, the Interconnection Customer is allocated \$0 for Shared Network Upgrades. If higher queued interconnection customers withdraw from the queue, suspend or terminate their GIA, restudies will have to be conducted to determine the Interconnection Customers' allocation of Shared Network Upgrades. All studies have been conducted on the basis of higher queued interconnection requests and the upgrades associated with those higher queued interconnection requests being placed in service. At this time, the Interconnection Customer is allocated the costs for Shared Network Upgrade shown in **Table 3**.

Table 3: GEN-2013-010/IFS-2014-002-01 Shared Network Upgrades

Shared Network Upgrades Description	Allocated Cost (\$)	Allocated Percent (%)	Total Cost (\$)
None			
Total			

Other Network Upgrades

Certain Other Network Upgrades are currently not the cost responsibility of the Customer but will be required for full Interconnection Service. Currently, the following Other Network Upgrades are required:

- Bucker – Spearville 345kV circuit #1 terminal equipment upgrade assigned DISIS-2010-002 Interconnection Customer.

Depending upon the status of higher or equally queued customers, the Interconnection Customer's in-service date is at risk of being delayed or their Interconnection Service is at risk of being reduced until the in-service date of these Other Network Upgrades.

Conclusion

Interconnection Service for GEN-2013-010/IFS-2014-002-01 will be delayed until the Transmission Owner Interconnection Facilities, Non-Shared Network, and Shared Network Upgrades are constructed. The Interconnection Customer is responsible for \$11,021,522 of Transmission Owner Interconnection Facilities and Non-Shared Network Upgrades.

At this time, the Interconnection Customer is allocated \$0 for Shared Network Upgrades. After all Interconnection Facilities and Network Upgrades have been placed into service, Interconnection Service for 99.00 MW, as requested by GEN-2013-010/IFS-2014-002-01, can be allowed.

**Generation Interconnection Facilities Study Report
For GEN 2013-010 – 99 MW Wind Generating Facility
In Rush County, Kansas.
September 15, 2015**



Table of Contents

1.0 Overview	3
1.1 Facility Study Summary	3
2.0 Voltage Guidelines	3
3.0 Network Upgrades.....	4
3.1 New ITCGP GEN 2013-010 Interconnection Substation.....	4
3.2 Loop Spearville to Post Rock line into GEN 2013-010 Interconnection Substation.....	8
4.0 Transmission Owner Interconnection Facilities.....	10
4.1 GEN 2013-010 – Interconnection Facilities	10
5.0 Interconnection Customer Interconnection Facilities	12
5.1 GEN 2013-010 Interconnection Facilities	12
6.0 Right of Way Requirements.....	13

1.0 Overview

ITC Great Plains (“ITCGP”) has performed a facility study at the request of Southwest Power Pool (“SPP”) for Generation Interconnection request GEN-2013-010 under the SPP Open Access Transmission Tariff. The subject request entails interconnecting a 99 MW wind powered generation facility in Rush County, Kansas. The project will interconnect at a new ITC GP GEN 2013-010 switching station on the Spearville to Post Rock line approximately 23 miles from the Post Rock Substation. It is scheduled for completion by December 31, 2016.

The ITCGP scope of this Facility Study is to provide a cost estimate for the Customer’s interconnection facilities. This study does not directly address any of the Network Upgrades that may be identified in the DISIS, the facilities that are being constructed by the interconnection customer, or any potential sub-transmission facilities (if any) that may be required.

1.1 Facility Study Summary

ITCGP estimates the total project cost of the customer’s interconnection facilities will be **\$ 11,021,522** (+/- 20 % accuracy) including applicable company overheads and potential tax gross-ups in 2015 dollars. It includes **\$ 10,308,147** for Network Upgrades and **\$ 713,375** for Transmission Owner Interconnection Facilities. It is further estimated that the required legal/real estate acquisition and construction activities will require approximately 24 months after the GIA is executed. The attached report contains additional details regarding the estimate as well as results of short circuit studies, review of reactive compensation, and information on Interconnection & Operating requirements.

The GEN 2013-010 interconnection facilities will require Network Upgrades on the ITCGP system to connect the new generation. Network Upgrades consist of the following:

- A new 3-breaker 345 kV ITCGP GEN 2013-010 interconnection station at the POI on the Spearville to Post Rock 345 kV line
- Looping in the Spearville to Post Rock 345 kV line into the new substation

In addition to the identified Network Upgrades, there are specific Interconnection Facilities which ITCGP will construct, own, operate, and maintain. These facilities include the new line entrance structure and 345kV disconnect switch on the end of the radial line from GEN 2013-010 at the ITCGP switching station as well as any ITCGP relaying and control equipment required for the protection of the developer’s radial line.

The Interconnection Customer is responsible for constructing all sole-use facilities such as the wind farm collector station and the radial 345kV line from the collector station to the new ITCGP switching station. While this report does define Interconnection Customer owned Interconnection Facilities in enough detail to explain basic requirements, it does not define or contain all of the detailed requirements. Additional metering, communications, and operational requirements may be identified as the Interconnection and Operating Agreements are developed and further communications between the Transmission Owner and Interconnection Customer take place. The Interconnection Customer’s low voltage system is not defined in this report.

2.0 Voltage Guidelines:

Reactive power, voltage regulation and operating requirements will be as per Transmission Operator (TOP) and Transmission Provider directives. Interconnection Customer will operate the Generating Facility to a voltage schedule of 350 kV (1.014 pu) with a bandwidth of +/- 6 kV (0.017 pu) at the Point of Interconnection (POI) utilizing the Generating Facility’s required power factor design capability as indicated in SPP DISIS-2013-001. As per SPP DISIS 2013-001, the Interconnection Customer’s required power factor capability is 0.95 lagging to 0.95 leading (at the POI).

For further clarification, the Interconnection Customer may meet the +/- 0.95 power factor requirement by utilizing reactive capability from the wind generators or by adding external reactive compensation. Note that any reactive compensation installed by the Interconnection Customer shall not cause voltage distortion in accordance with Article 9.7.6 Power Quality of the Generation Interconnection Agreement.

The Interconnection Customer will regulate the Generating Facility's voltage to the specified voltage set-point within the defined bandwidth stated above using an automatic voltage controller utilizing the inherent reactive power capability in the wind turbines and if applicable external reactive compensation.

The above voltage schedule is subject to change. If the need for a change is identified, it will be done within the limits of the GIA provisions stated in Section 9.6 and the Generating Facility's power factor design criteria as stated above. If a schedule change is needed, appropriate written documentation of the change will be provided to the Interconnection Customer.

The Interconnection Customer is required to have a generator operator available for 24/7 communication with the TOP. The TOP may, at any time request a variance from the schedule in response to system operating/security requirements.

3.0 Network Upgrades

3.1 New ITCGP GEN 2013-010 interconnection substation

3.1.1 Project Location:

This switchyard will be located at approximately 23 miles from the Post Rock Substation on the Spearville to Post Rock 345kV line in Rush County, Kansas.

3.1.2 Project Overview:

The purpose of this project is to build a 345kV switchyard to provide a transmission system interconnection for the GEN 2013-010 Wind Farm. The switchyard will consist of three 345kV circuit breakers arranged in a breaker and a half configuration.

The new 345kV switchyard will have a new control house with adequate AC and DC station service supplies, new control and protection panels and a new RTU for communication with the Transmission Owner's master control station.

The new switchyard will cut into the 345kV Spearville to Post Rock line.

3.1.3 Design Criteria:

The Transmission Owner's standards will be applicable. Where no applicable standards are available, the Transmission Owner will substitute industry standards and other good utility practices.

3.1.4 One-Line Diagrams:
See Figure 1 for Transmission Owner One-Line.

GEN-2013-010 Interconnection Substation Option 2

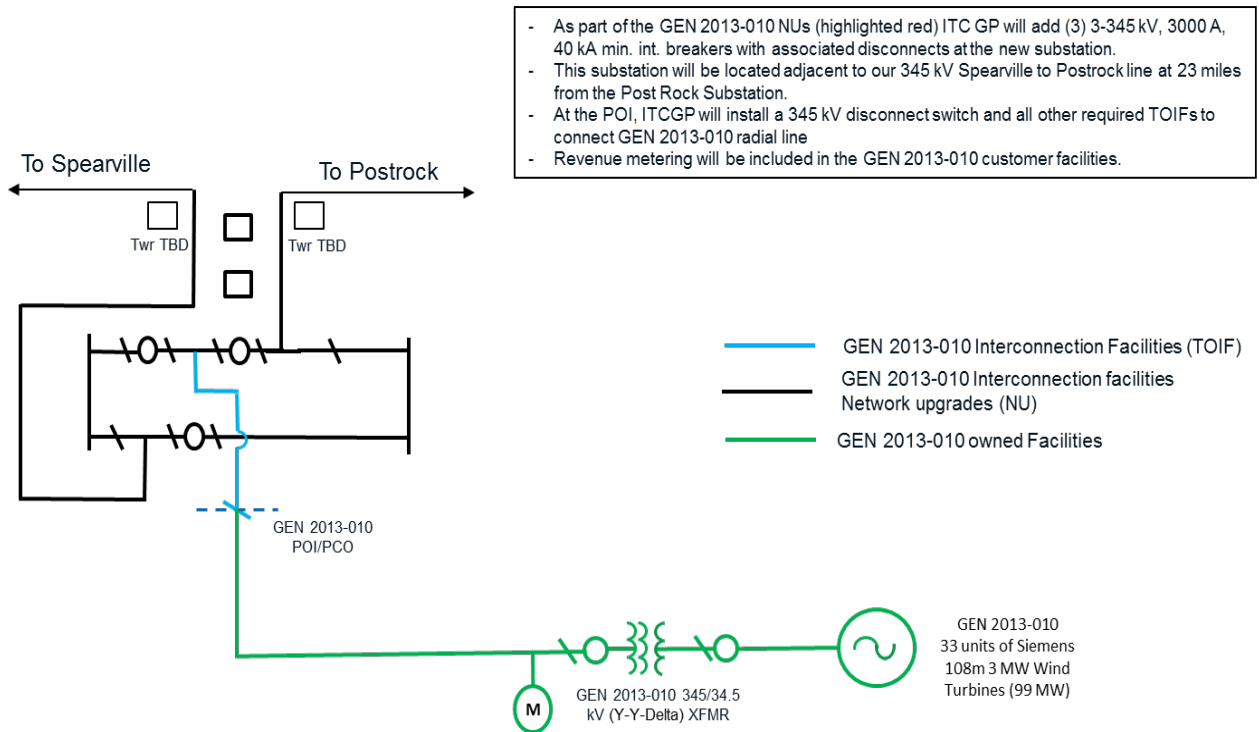


Figure 1 GEN-2013-010 ITCGP Interconnection Substation One Line

3.1.5 Site Plan:

See Figure 2 for site plan of Transmission Owner switching station at the POI on Spearville to Post Rock 345kV line.

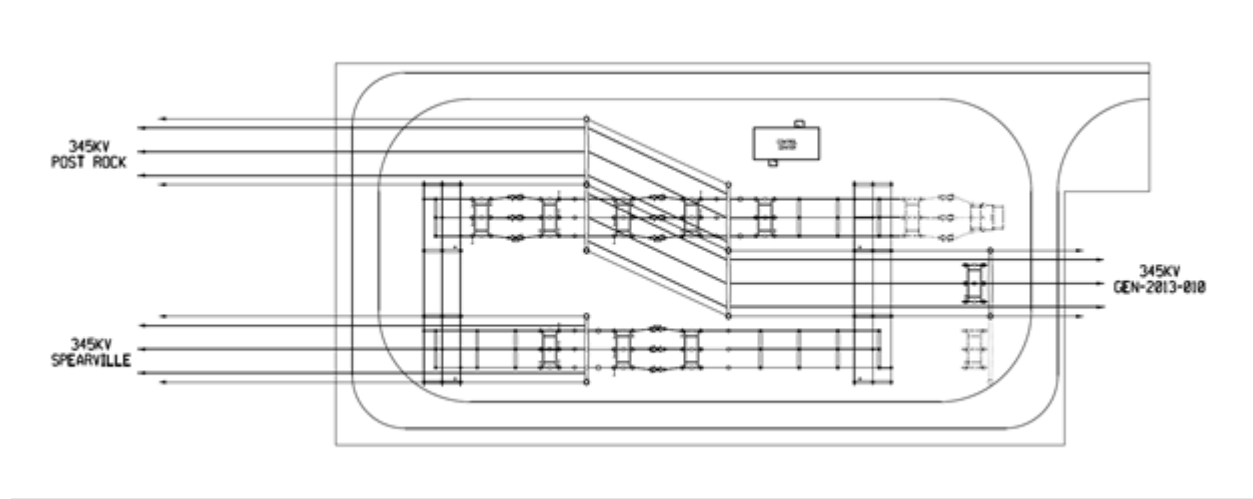


Figure 2 GEN-2013-010 ITCGP Interconnection Substation Site Plan

3.1.6 Route Information: N/A

3.1.7 Right-of-Way Information:

It is assumed that the interconnection customer will be responsible for building the 345 kV line required to connect the ITCGP Switching Station at the POI with the customer's substation. As such, the interconnection costs contained herein do not include any costs for extending the ITCGP transmission line. Please see section 6 for general guidelines.

3.1.8 Permitting:

The Interconnection Customer will be responsible for satisfying all community or governmental site plan or zoning approval requirements which may include wetland or flood plain permits. The Transmission Owner will be responsible for the control center building permit and the KDHE storm water construction permits associated with the Transmission Owner portions of the construction.

3.1.9 Metering & Ownership Demarcation:

Covered in section 4.1.9

3.1.10 Protection & Control Overview:

Two sets of 345kV CCVTs will be installed, one set for each line.

Two 345kV wave traps will be installed for each line.

Three 345kV breaker control panels with microprocessor based relays will be installed. Breaker failure protection, automatic reclosing supervised by synchronism check will be provided.

Two 345kV line relaying panels with microprocessor based relays will be installed.

3.1.11 Insulation Coordination:

345kV, 1050kV BIL

3.1.12 Short Circuit Study Results - Bus Fault Levels:

ITCGP calculated bus fault levels for the interconnection substation and adjacent substations to determine if the added generation will cause fault currents to exceed interrupting ratings for existing equipment and for use in sizing future equipment. Calculations are based on data for the interconnection transformer and installed wind turbines supplied by the Interconnection Customer. Variance from supplied data could materially change calculated short circuit values. Results are displayed in Table 1.

Table 1 – Short Circuit Results

Fault Location	Maximum Fault Current (Amps)	
	Phase	Ground
Spearville Substation	14257	14502
Post Rock 345 kV Bus	8042	7557
GEN 2013-010 345 kV Bus	8077	6088

Fault currents shown in Table 1 are within the circuit breaker interrupting capabilities with the addition of 99 MW contributed by GEN-2013-010.

3.1.13 Reactive Compensation:

ITCGP evaluated the impact of the proposed interconnection on the reactive compensation equipment presently planned or in service for the Spearville and Post Rock Substation facilities, including the addition of a reactor at the GEN 2011-017 interconnection substation. ITCGP studies concluded that no additional reactive compensation is required for interconnection of GEN 2013-010. It has also been determined that if the GEN 2011-017 project is not completed prior to GEN 2013-010 or is otherwise withdrawn from the queue or has its interconnection agreement terminated, no additional reactive compensation is required at the GEN-2013-010 interconnection substation due to transmission system considerations.

3.1.14 Other Equipments & Materials:

- Gas Circuit Breakers (GCB): three (3) 345 kV, 3000A rated, 63kAIC.
- Disconnect Switch: eight (8) 345 kV, 3000A rated, 1050 kV BIL.

- CCVTs: six (6) 345kV, 3-winding, 1550kV BIL.
- Insulators: sixty (60) 345 kV, 1050 kV BIL station post, porcelain.
- Wave traps: four (4) 345kV, 3000A, double frequency.
- Surge Arresters: six (6) 345kV, vertical mount, 209MCOV, polymer.
- Control Cable: Control cables per Transmission Owner standards will be installed in direct buried PVC conduits, above grade LFMC conduits and in pre-cast cable trench. All control cables from the yard will be terminated at the relaying control panels. The control building will have overhead cable trays for necessary cable runs and inter-panel connections.

3.1.15 Relaying, Control, & SCADA: Panel Requirements

- 3 – RD3024 – Tie Breaker Control (SEL-351S)
- 2 – RD3070 – “A” Line Relaying, Carrier (SEL-421 & UPLC)
- 2 – RD3076 – “B” Line Relaying, Carrier (SEL-311C & UPLC)

3.1.16 Grounding System:

The grounding system will be designed and installed per Transmission Owner’s standards. These standards follow the IEEE 80 standards.

3.1.17 Lightning Shielding Design:

Lightning shielding will be provided per Transmission Owner’s standards. Multiple H-frame structures along with shield wire will be used for lightning protection.

3.1.18 Yard Lighting:

Yard lighting will be installed to be sufficient for visual indication of the disconnect switch positions or egress of personnel, and will not serve as task lighting.

3.1.19 Structures:

The required new outdoor steel structures listed below will be hot-dipped galvanized wide flange structures or tubular steel:

- Eight (8) 345 kV disconnect switch stands
- Nineteen (19) 345 kV bus support
- Four (4) 345kV wave trap stands
- Three (3) H-frame line entrance structures
- Six (6) 345kV CCVT stands
- Six (6) 345kV surge arrester stands

3.1.20 Foundations:

Foundations and slabs will be designed and installed in accordance with the owner’s standards and specifications. The minimum design depth to firm bearing is contingent upon soil borings at the site.

3.1.21 Scheduling Requirements:

Legal/Real Estate Procurement	9 weeks
Material Procurement / Design	52 weeks
Substation Construction	32 weeks
Closeout Activities	4 weeks

3.1.22 Site Work:

Site grading will be required for the new 345kV switchyard.

3.1.23 Total Cost: \$9,512,390

Total Cost Estimate Accuracy: +/- 20%

Note that the cost estimate provided is expressed in 2015 terms and includes applicable company overheads and potential tax gross ups.

3.2 Loop Spearville to Post Rock line into GEN 2013-010 interconnection substation

3.2.1 Project Location:

The new switchyard will be located at approximately 23 miles from the PostRock Substation on the Spearville to Post Rock line in Rush county, Kansas.

3.2.2 Project Overview:

The project involves opening the existing Spearville to Post Rock 345 kV line and looping it into the new GEN 2013-010 Interconnection Substation.

3.2.3 Design Criteria:

Design Standards will be Transmission Owner Standards. Where no applicable standards are available, the Transmission Owner will utilize industry standards and good Utility practices.

3.2.4 One-Line Diagrams: N/A

3.2.5 Site Plan: N/A

3.2.6 Route Information:

The routing associated with looping the Spearville to Post Rock circuit into the GEN 2013-010 Sub is minimal and will be contained to the property surrounding the GEN 2013-010 Substation.

3.2.7 Right-of-Way Information:

The new transmission line structures will be located on existing easement or on the new substation property. Please see section 6 for general guidelines

3.2.8 Permitting:

Same as that covering section 3.1.8.

3.2.9 Metering & Ownership Demarcation: N/A

3.2.10 Protection & Control Overview: N/A

3.2.11 Insulation Coordination: N/A

3.2.12 Short Circuit Study Results - Bus Fault Levels: N/A

3.2.12 Other Equipments & Materials: N/A

3.2.13 Relaying, Control, & SCADA: N/A

3.2.14 Grounding System: N/A

3.2.15 Lightning Shielding Design:

Lightning shielding design will be in accordance with the Transmission Owner's standards and specifications.

3.2.16 Yard Lighting: N/A

3.2.17 Structures:

The new transmission line structures will be 345 kV galvanized steel monopoles or lattice towers, pending the most feasible and appropriate design. Two structure(s) will be required to loop the line into the new station.

3.2.18 Foundations:

Foundations will be designed and installed in accordance with the Transmission Owner's standards and specifications. The transmission structure foundations will be drilled piers.

3.2.19 Conductors, Shield Wires, & OPGW:

The conductor will be a bundled T2-477 kcmil (26/7) ACSR "Hawk" per phase. The shield wire will be 159 kcmil (12/7) ACSR "Guinea."

3.2.20 Insulators:

Insulators will be 345 kV polymer insulators.

3.2.21 Removal of Existing Facilities:

TBD – tentatively no existing facilities will be removed.

3.2.22 Site Work: N/A

3.2.23 Total Cost: \$ 795,757

Total Cost of Network Upgrades: 9,512,390 + 795,757 = 10,308,147

Total Cost Estimate Accuracy: +/- 20%

Note that the cost estimate provided is expressed in 2015 terms and includes applicable company overheads.

4.0 Transmission Owner Interconnection Facilities

4.1 GEN 2013-010 – Interconnection Facilities

4.1.1 Project Location:

This switchyard will be located approximately 23 miles from the Post Rock Substation on the Spearville to Post Rock line in Rush County, Kansas.

4.1.2 Project Overview:

A new line entrance structure will be added at the ITCGP GEN 2013-010 interconnection switchyard for termination of the line from the collector substation. A disconnect switch will be installed beneath this structure for isolation of the developer's line. Line relaying will be added to protect the line. A set of CCVT's and surge arresters will be added to the line terminal.

4.1.3 Design Criteria:

The Transmission Owner's standards will be applicable. Where no applicable standards are available, the Transmission Owner will substitute industry standards and other good utility practices.

4.1.4 One-Line Diagrams: See Figure 1

4.1.5 Site Plan: See Figure 2.

4.1.6 Route Information: N/A

4.1.7 Right-of-Way Information: N/A

4.1.8 Permitting: Same as that covering section 3.1.8

4.1.9 Metering & Ownership Demarcation:

The Interconnection Customer or others will provide, own, operate and maintain revenue metering. The specifics of the revenue metering will be defined during the detailed engineering phase of the project. The customer must cooperate with the Transmission Provider and Local Transmission Owner requirements in the metering design. Revenue metering equipment will be required at customer's project substation with loss compensation to the Point of Interchange in the Transmission Owner's substation.

The ownership demarcation will be at first substation steel H-frame within the security fence of the Transmission Owner substation.

The Interconnection Customer will be required to provide enough conductor to terminate on the H-frame and extend down to reach grade level.

4.1.10 Protection & Control Overview:

- One set of 345kV CCVTs will be installed on the GEN 2013-010 line.
- Two paths of fiber optic cable (OPGW) will be required for line protection. They will be supplied by the Interconnection Customer.
- One 345kV line relaying panel with microprocessor based relays will be installed.

4.1.11 Insulation Coordination:

345kV, 1050kV BIL

4.1.12 Short Circuit Study Results - Bus Fault Levels: See Section 3a above

4.1.13 Other Equipments & Materials:

- Disconnect Switch: One (1) 345 kV, 3000A rated, 1050 kV BIL.
- CCVTs: Three (3) 345 kV, 3-winding, 1550kV BIL.
- Surge Arresters: Three (3) 345 kV, vertical mount, 209 kV MCOV, polymer.
- Control Cables: Control cables per Transmission Owner standards will be installed in direct buried PVC conduits, above grade LFMC conduits and in pre-cast cable trench. All control cables

from the yard will be terminated at the relaying control panels. The control building will have overhead cable trays for necessary cable runs and inter-panel connections.

4.1.14 Relaying, Control, & SCADA:

Panel Requirements: One RD3048 Panel – Fiber optic current differential (SEL 311L Relays)

4.1.15 Grounding System:

The grounding system will be designed and installed per Transmission Owner's standards. These standards follow the IEEE 80 standards.

4.1.16 Lightning Shielding Design:

The attachment of the OPGW shield wire from the developer's line to the H-frame will provide lightning protection for the Interconnection Facility equipment at GEN 2013-010 interconnection substation.

4.1.17 Yard Lighting:

Yard lighting will be installed to be sufficient for visual indication of the disconnect switch position or egress of personnel, and will not serve as task lighting.

4.1.18 Structures:

The required new outdoor steel structures listed below will be hot-dipped galvanized wide flange structures or tubular steel:

- One (1) 345 kV disconnect switch stand
- Two (2) H-frame line entrance structures
- Three (3) 345 kV CCVT stands
- Three (3) 345 kV surge arrester stands

4.1.19 Foundations:

Foundations will be designed and installed in accordance with the owner's standards and specifications. The minimum design depth to firm bearing is contingent upon soil borings at the site.

4.1.20 Conductors, Shield Wires, & OPGW: N/A

4.1.21 Insulators: N/A

4.1.22 Removal of Existing Facilities: N/A

4.1.23 Site Work: N/A

4.1.24 Total Cost: \$ **713,375**

Total Cost Estimate Accuracy: +/- 20%

Total Project cost (Network Upgrades and Interconnection facilities): \$ 11,021,522

Note that the cost estimate provided is expressed in 2015 terms and includes applicable company overheads and potential tax gross ups.

5.0 Interconnection Customer Interconnection Facilities

5.1 GEN 2013-010 Interconnection facilities

All facilities within the Interconnection Customer's collector substation and between the Interconnection Customer's substation and ITCGP's new GEN 2013-010 interconnection substation are not included in this report and are the sole responsibility of the Interconnection Customer. Some of the key facilities are briefly mentioned below. The Point of Interconnection (POI) and the Point of Change of Ownership (PCO) are shown in Figure.

The Interconnection Customer shall construct the 345 kV radial line from the wind farm collector station to ITCGP's new GEN 2013-010 interconnection substation. Installation of OPGW shield wire on the radial line from GEN 2013-010 containing at least 12 single mode fibers will be required for ITCGP relaying and communication purposes.

The customer's step-up transformer between the wind farm's 34.5 kV collector network and the 345 kV facilities will require a high side breaker capable of interrupting a transformer high side winding fault.

All Interconnection Customer owned 345 kV apparatus as well as the revenue metering equipment located in the Interconnection Customer's substation shall comply with ITCGP standards and will be subject to ITCGP approval. ITCGP will provide the Interconnection Customer with standards during detailed design or upon request. The Interconnection Customer is solely responsible for the SCADA and telecommunications facilities necessary to operate and monitor its facility.

Necessary trip and close signal interlocks will be provided by ITCGP to the Interconnection Customer's generation facility for the safe operation of the system. Interconnection Customer will provide breaker status and current transformer signals to ITCGP for system operation and protection.

Total Project Cost: N/A
Total Cost Estimate Accuracy: N/A

6.0 Right Of Way Requirements

The Interconnection Customer shall obtain easements from the Transmission Owner to work in or drive through the Transmission Owner's transmission line right-of-way. The Transmission Owner and Interconnection Customer will also cooperatively negotiate any easements required for the Interconnection Customer's transmission lines and structures. The Transmission Owner agrees to not unreasonably withhold easements.

For the Network Upgrades and any Transmission Owner Interconnection facilities identified in this report, the Transmission Owner agrees to obtain all necessary easements/right-of-way as required to construct those facilities that will be owned and operated by ITCGP.