



## **Interconnection Facilities Study**

**Costs associated with  
DISIS-2022-001  
GEN-2022-013/024**

**October 2025**

## **Introduction**

This report summarizes the scope of the Interconnection Facilities Analysis for Network Upgrade(s) to determine costs related to the addition of the SPP-GI DISIS-2022-001 Interconnection Request(s). Evergy, as a TO, is receiving an unprecedented amount of GI interconnect requests. The cost estimates and interconnect information supplied are based on current system configuration. There are many cases of multiple GI's requesting POIs at the same substation. Ongoing changes in Evergy's transmission system configuration could affect the required system upgrades and costs necessary to meet any particular GI interconnect request in the future.

## **Southwest Power Pool Generation Interconnection Request:**

Per the SPP Generator Interconnection Procedures (GIP), SPP has requested that Evergy perform an Interconnection Facilities Study (IFS) for Network Upgrade(s) in accordance with the Scope of Interconnection Facilities Study GIP Section 8.10 and the Interconnection Facilities Study Procedures in accordance with GIP Section 8.11 for the following Interconnection Request(s):

Upgrade Type	UID	Upgrade Name	DISIS Cost Estimate	DISIS Lead Time
Interconnection	158376	Tap of Neosho - LaCygne 345 kV Line GEN-2022-013 Interconnection (TOIF) (EKC)	\$ 1,898,669.00	56 Months
Interconnection	158377	Tap of Neosho - LaCygne 345 kV Line GEN-2022-024 Interconnection (TOIF) (EKC)	\$ 112,911.00	24 Months
Interconnection	158378	Tap of Neosho - LaCygne 345 kV Line Interconnection (DISIS-2022-001) (EKC)	\$ 31,493,296.00	56 Months

### **Tap of Neosho - LaCygne 345 kV Line GEN-2022-013 Interconnection (TOIF) (EKC)**

#### **345kV Substation**

TOIF for accommodating Savannah Solar GEN-2022-013 (300MW of Solar) at a greenfield 345kV Substation on the Neosho - LaCygne 345 kV line. This estimate is the cost associated with the Transmission Owner Interconnection Facilities for a terminal at a new substation on the Neosho - LaCygne 345 kV line for GEN-2022-013. UID 158376

#### **Total Cost**

The total cost estimate for this TOIF is:

\$ 0	Transmission Line
\$ 1,737,716	Substation
\$ 5,679	AFUDC
\$ 155,274	Contingency
<hr/>	
\$ 1,898,669	Total

This estimate is accurate to +/- twenty (20) percent, based on current prices, in accordance with Attachment A of Appendix 4 of the Interconnection Facilities Study Agreement. However, recent cost fluctuations in materials are very significant and the accuracy of this estimate at the time of actual settings cannot be assured.

#### Time Estimate

Time estimates are based on current version of the project schedule and some processes of each category run concurrently.

Engineering Time	48-56	Months
Procurement Time	48-56	Months
Construction Time	48-56	Months
Total Project Length	48-56	Months

### **Tap of Neosho - LaCygne 345 kV Line GEN-2022-024 Interconnection (TOIF) (EKC)**

#### 345kV Substation

TOIF for accommodating Savannah Solar GEN-2022-024 (200MW of Battery/Storage) at a greenfield 345kV Substation on the Neosho - LaCygne 345 kV line. This estimate is the cost associated with the Transmission Owner Interconnection Facilities for a shared terminal with GEN-2022-013 at a new substation on the Neosho - LaCygne 345 kV line for GEN-2022-024 and includes relay settings review/upgrades only. UID 158377

#### Total Cost

The total cost estimate for this TOIF is:

\$	0	Transmission Line
\$	112,574	Substation
\$	337	AFUDC
\$	0	Contingency
\$	112,911	Total

This estimate is accurate to +/- twenty (20) percent, based on current prices, in accordance with Attachment A of Appendix 4 of the Interconnection Facilities Study Agreement. However, recent cost fluctuations in materials are very significant and the accuracy of this estimate at the time of actual settings cannot be assured.

#### Time Estimate

Time estimates are based on current version of the project schedule and some processes of each category run concurrently.

Engineering Time	18-24	Months
Procurement Time	18-24	Months
Construction Time	18-24	Months
Total Project Length	18-24	Months

## **Tap of Neosho - LaCygne 345 kV Line Interconnection (DISIS-2022-001) (EKC)**

### **345kV Substation**

Network Upgrades to construct a greenfield 345kV ring bus substation on the Neosho-LaCygne 345kV line to accommodate Savannah Solar GEN-2022-013/024 (300MW of Solar and 200MW of Battery/Storage). The transmission line estimate assumes that the substation will be located directly adjacent to the existing line, with no additional easements required. UID 158378

### **Total Cost**

The total cost estimate for this Network Upgrade is:

\$	1,768,500	Transmission Line
\$	26,725,486	Substation
\$	94,198	AFUDC
\$	2,905,112	Contingency
<hr/>		
\$	31,493,296	Total


This estimate is accurate to +/- twenty (20) percent, based on current prices, in accordance with Attachment A of Appendix 4 of the Interconnection Facilities Study Agreement. However, recent cost fluctuations in materials are very significant and the accuracy of this estimate at the time of actual settings cannot be assured.

### **Time Estimate**

Time estimates are based on current version of the project schedule and some processes of each category run concurrently.

Engineering Time	48-56	Months
Procurement Time	48-56	Months
Construction Time	48-56	Months
Total Project Length	48-56	Months

**Figure 1 – Neosho-LaCygne 345kV Line**

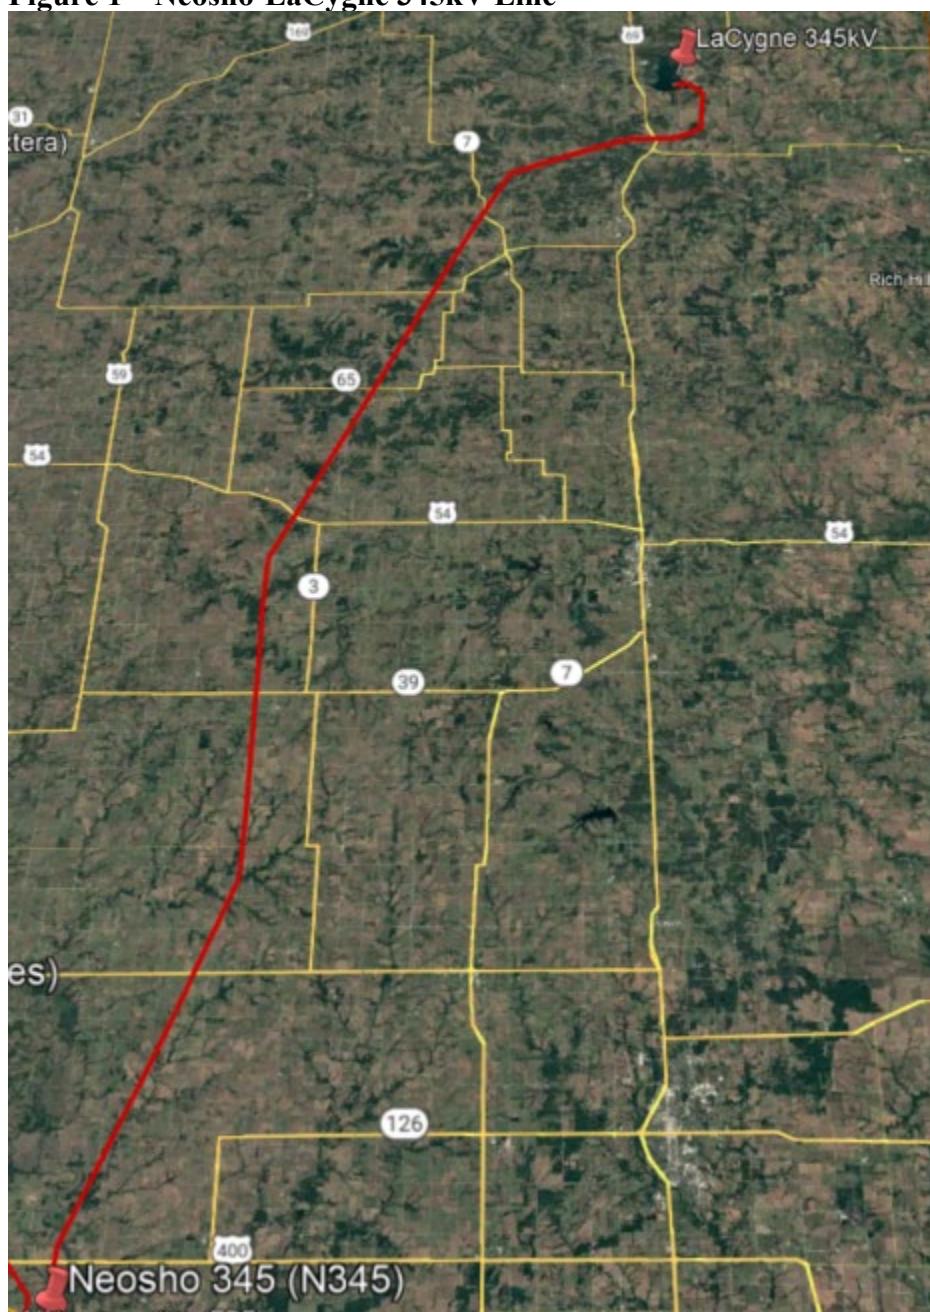



## Current Study

**Costs associated with  
DISIS-2022-001  
Build a new EMPEC-Gen-2021-096  
345kV Line 1 to 1180 MVA  
October 2025**

## **Introduction**

This report summarizes the scope of the Interconnection Facilities Analysis for Network Upgrade(s) to determine costs related to the addition of the SPP-GI DISIS-2022-001 Interconnection Request(s). Evergy, as a TO, is receiving an unprecedented amount of GI interconnect requests. The cost estimates and interconnect information supplied are based on current system configuration. There are many cases of multiple GI's requesting POIs at the same substation. Ongoing changes in Evergy's transmission system configuration could affect the required system upgrades and costs necessary to meet any particular GI interconnect request in the future.

## **Southwest Power Pool Generation Interconnection Request:**

Per the SPP Generator Interconnection Procedures (GIP), SPP has requested that Evergy perform an Interconnection Facilities Study (IFS) for Network Upgrade(s) in accordance with the Scope of Interconnection Facilities Study GIP Section 8.10 and the Interconnection Facilities Study Procedures in accordance with GIP Section 8.11 for the following Interconnection Request(s):

Upgrade Type	UID	Upgrade Name	DISIS Cost Estimate	DISIS Lead Time
Current Study	170692	Build a new EMPEC-Gen-2021-096 345kV Line 1 to 1180 MVA	\$ 97,742,347.00	56 Months

### **Build a new EMPEC-Gen-2021-096 345kV Line 1 to 1180 MVA**

#### **345kV Line**

Network Upgrades to build a new 345kV line from Emporia Energy Center-Gen-2021-096 Line 1 to a minimum of 1180 MVA. This upgrade includes substation upgrades, for both GEN-2021-096 345kV substation and Emporia Energy Center 345kV and new line between the two substations. GEN-2021-096 345kV substation will be converted to a breaker and half configuration with a new rung for a new line terminal. Emporia Energy Center 345kV substation will add a new rung and a new line terminal for the additional line. The transmission line estimates include a 25 mile long greenfield 345kV circuit, built to a 3000 amp standard. New easements, routing study and KCC siting application will be required. UID 170692

#### **Total Cost**

The total cost estimate for this Network Upgrade is:

\$ 75,456,000	Transmission Line
\$ 20,255,654	Substation
\$ 286,349	AFUDC
\$ 1,744,344	Contingency
<hr/>	
\$ 97,742,347	Total

This estimate is accurate to +/- twenty (20) percent, based on current prices, in accordance with Attachment A of Appendix 4 of the Interconnection Facilities Study

Agreement. However, recent cost fluctuations in materials are very significant and the accuracy of this estimate at the time of actual settings cannot be assured.

### Time Estimate

Time estimates are based on current version of the project schedule and some processes of each category run concurrently.

Engineering Time	48-56	Months
Procurement Time	48-56	Months
Construction Time	48-56	Months
Total Project Length	48-56	Months

**Figure 1 – Build a new line from Emporia Energy Center-GEN-2021-096 345kV Line 1**





# Liberty

---

## **Generation Interconnection Facilities Study**

**for**

**DISIS-2022-001 Network Upgrades  
UID 170693**

**“Rebuild the RIV452 5 to G20-079-TAP  
161kV Line 1 (EMDE)”**

---

Created 10/28/2025

## **Introduction**

At the request of Southwest Power Pool (SPP), The Empire District Electric Company (d/b/a Liberty) has compiled the following Facility Study for SPP to comply with the DISIS-2022-001 Network Upgrade study results.

## **Project Description**

DISIS-2022-001 UID 170693 proposes to rebuild the 161kV line from Riverton Rams Sub 452 to the soon-to-be-installed G20-079 substation (Rainbow Springs) in southeast Kansas, including replacing any necessary terminal equipment, to meet a required minimum 650 MVA capacity in all seasons.

## **Liberty's Scope of Work**

Liberty will rebuild and reconductor 5.47 miles of the 161kV line from bundled 795 ACSR to bundled 795 ACSS shown in Figure 1. Additionally, Liberty will replace two (2) 2000A circuit breakers and five (5) 2000A ganged disconnect switches with 3000A equipment at Riverton Rams Sub 452 shown in Figure 2, as well as replace two (2) 2000A circuit breakers and (5) 2000A ganged disconnect switches with 3000A equipment at the G20-079 (Rainbow Springs) substation.


Liberty reserves the right to specify the final acceptable configuration considering design practices, future expansion, and compliance requirements.

## **Interconnection Estimated Costs and Lead-Times**

<b>Total Cost &amp; Lead-time</b>	
<b>Network Upgrades (NU)</b>	
- Rebuild 5.47 miles of 161kV line with double-795 ACSS; (4) 161kV, 3000A breakers; (10) 161kV, 3000A switches	
<b>Total</b>	<b>\$9,770,036</b>
<b>Lead time</b>	36 Months

**Table 1 – Cost Estimate**

**Figure 1 – Impacted Transmission Line and Substations**

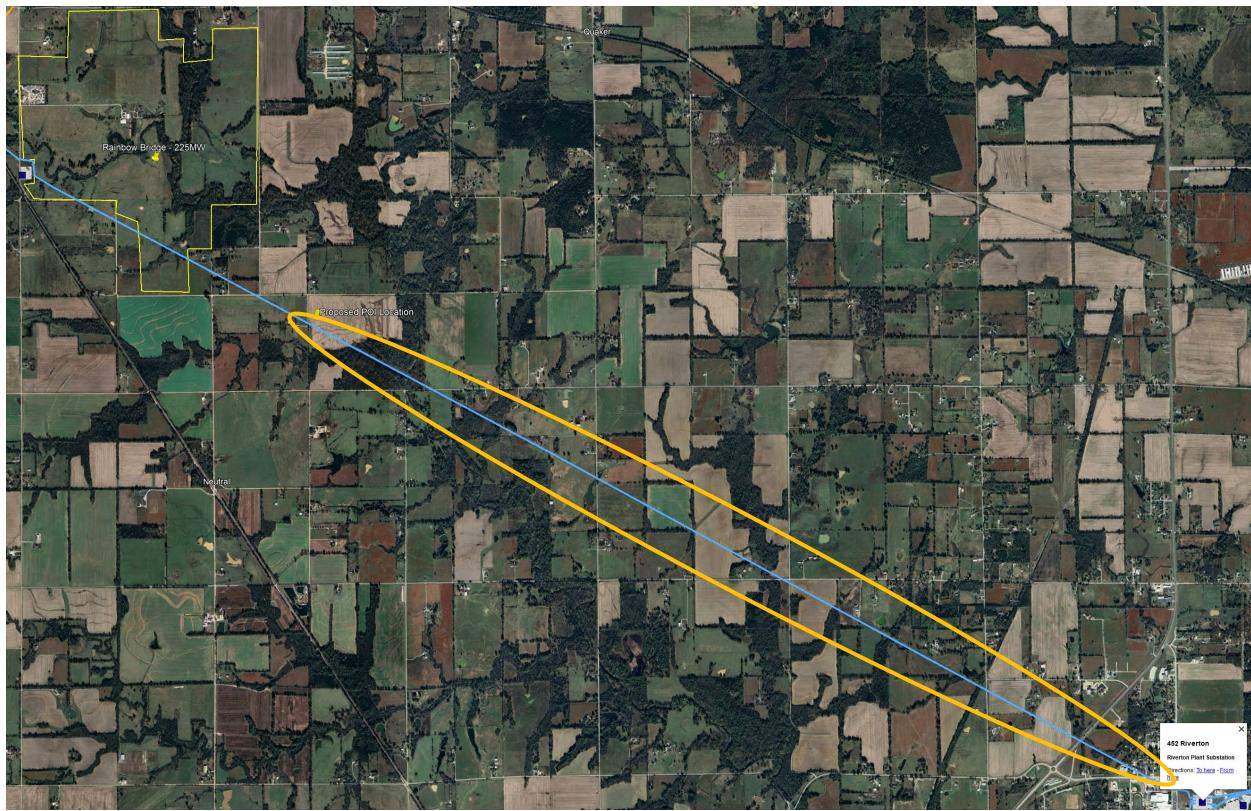

**Figure 2 – Preliminary One-Line for Riverton Sub 452 and Rainbow Springs Sub 523**

