

*wfec*  
western farmers  
electric cooperative

A Touchstone Energy® Cooperative 

## **INTERCONNECTION FACILITY STUDY**

**for**

## **Generation Interconnection Request 2023-092**

**125MW Hybrid Solar/Storage Generation Interconnection  
in Choctaw County, OK.**

**January 2026**

## SUMMARY

Pursuant to the tariff and at the request of the Southwest Power Pool (SPP), Western Farmers Electric Cooperative (WFEC) performed the following facility Study to satisfy the Facility Study agreement executed by the requesting customer for SPP Generation Interconnection request GEN-2023-092. The request for interconnection was placed with SPP in accordance with SPP's Open Access Transmission Tariff, which covers new generation interconnections on SPP's transmission system. The requirements for interconnection consist of installing OPGW on the Hugo Switch-Bennington Switch transmission circuit and building a new 138kV station at the POI with breakers and relaying operating as a 3-breaker ring bus. The total cost for WFEC to accommodate the interconnection request at the 138kV POI is \$15,500,000.



## Table of Contents

Introduction .....	4
Interconnection Facilities.....	5
Interconnection Cost.....	8
Figure 1: One-line Diagram Facilities for GEN-2023-092 .....	5

## Introduction

The Southwest Power Pool has requested a facility Study for the purpose of interconnecting 125MW of Solar/Storage Hybrid Generation within the service territory of WFEC in Choctaw County, Oklahoma.

The proposed 138kV POI (34.040278, -95.4975) is in between West Bank Tap and Frogville Substation on the Bennington to Hugo 138kV transmission circuit.

The cost for adding a new 138kV Switching Station (Heel Stone Switch Station) at the POI with breakers, relaying, and OPGW is estimated at \$15,500,000.

Network constraints within WFEC may be verified with a transmission service request and associated studies.

## Interconnection Facilities

The primary objective of this study is to identify WFEC interconnection facilities. Figure 1 below shows the proposed interconnection of GEN-2023-092.

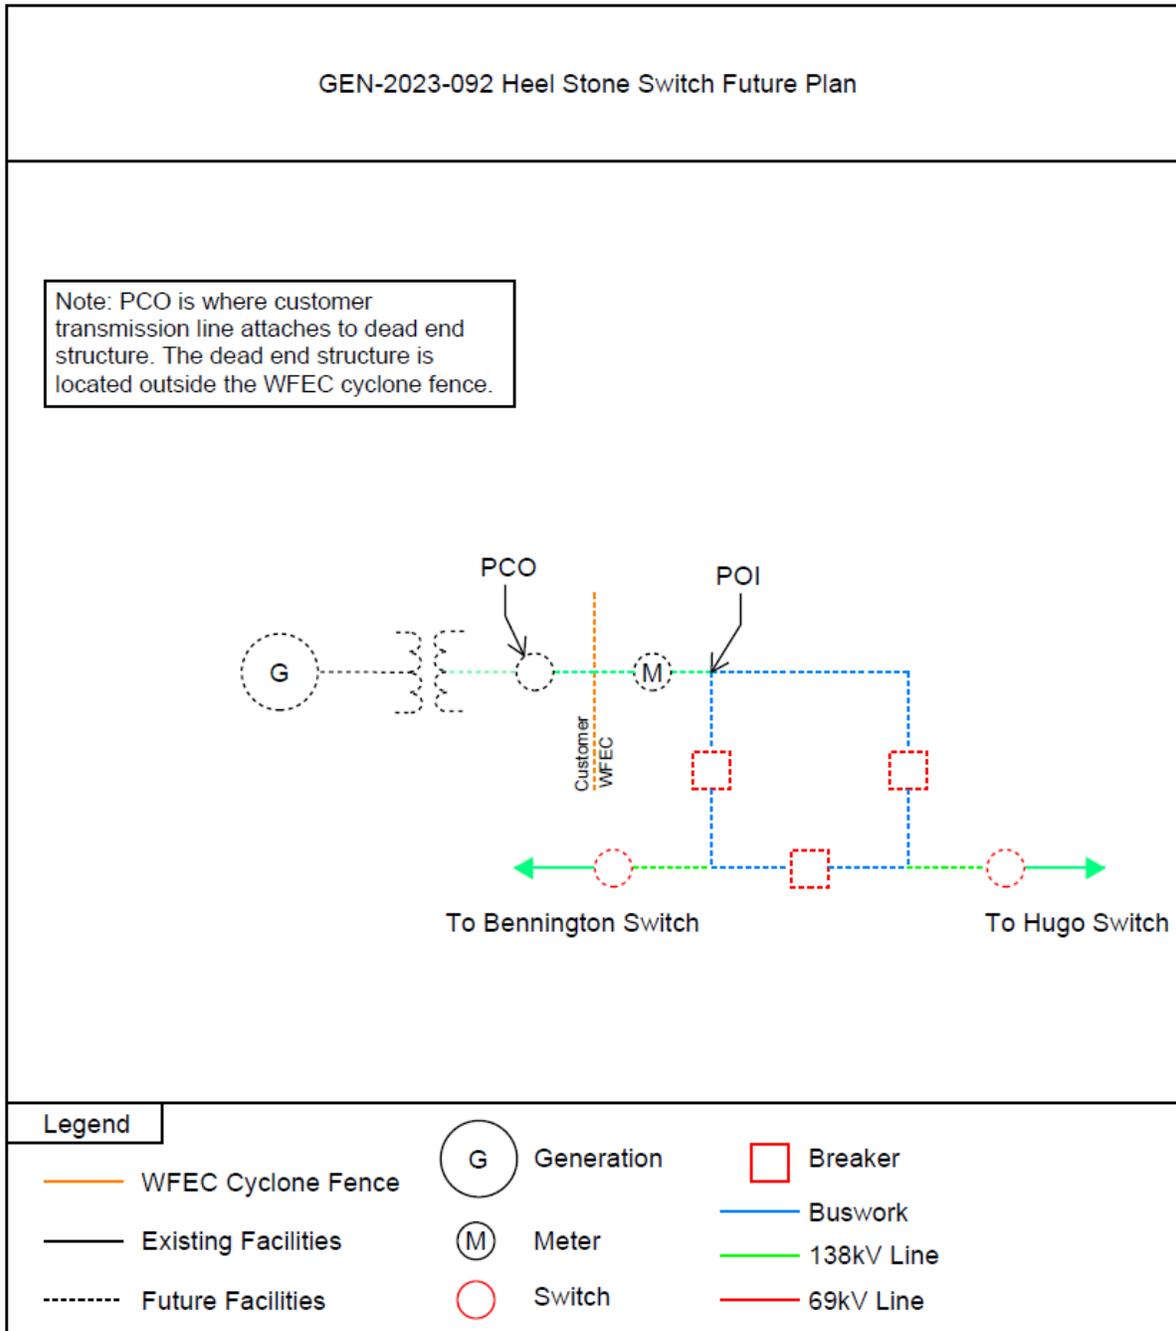


Figure 1: One-line Diagram Facilities for GEN-2023-092

To accommodate an interconnection for GEN 2023-092 WFEC will construct a new 138kV three-breaker ring bus, equipping a terminal for the following three lines: Bennington, Hugo, and the customer's GEN-2023-092 138kV interconnecting transmission line. The customer will construct a new 138kV transmission line from their collector sub to the point of demarcation. WFEC will require the customer to install OPGW for communications from Customer's collector sub to WFEC's switch station.

The total cost for the interconnection facilities at POI is estimated at \$15,500,000. This cost does not include the construction of the 138kV line from the customer substation to the point of demarcation at the edge of WFEC's property. The customer is responsible for this 138kV line up to the point of interconnection.

This facility study does not guarantee the availability of transmission service necessary to deliver additional generation to any specific point inside or outside of the SPP transmission system. The transmission network facilities may not be adequate to deliver any additional generation output to the system. If the customer requests firm transmission service under the SPP open access transmission tariff at a future date, Network Upgrades or other new construction may be required to provide the service requested under the SPP OATT.

**Short Circuit Fault Duty Evaluation:**

It is standard practice for WFEC to recommend replacing a circuit breaker when the current through the breaker for a potential fault exceeds 100% of its interrupting rating, as determined by the ANSI/IEEE standard C37-010-2016 breaker rating methods. Existing levels of available fault current at the nearby Bennington and Hugo 138kV station is shown below. As an inverter-based resource (IBR) the maximum fault current contribution is estimated at 1.4 times peak load current of the Inverter during the subtransient period. This equates to an increase in available fault current of approximately 730A at the POI, so no existing breakers are expected to exceed capacity with the proposed interconnection.

WFEC has evaluated the potential maximum fault current in this area and no issues with short circuit duty ratings are expected on existing WFEC breakers with the proposed interconnection of 125MW of hybrid generation on the Bennington - Hugo 138kV transmission circuit.

Table 1: WFEC Bennington and Hugo Switch Station 138kV Breaker Capacity

<b>BUS</b>	<b>BREAKER</b>	<b>DUTY %</b>	<b>DUTY (A)</b>	<b>BKR CAPACITY (A)</b>
Bennington Switch Station 138kV	138kV Breakers (x4)	12%	4700 (3LG)	40000
Hugo Switch Station 138kV	138kV Breakers (x3)	46%	29000 (1LG)	63000
Hugo Switch Station 138kV	138kV Breakers (x8)	73%	29000 (1LG)	40000

## Interconnection Cost

Table 2: Transmission Owner Interconnection Facilities

Transmission Owner Interconnection Facilities (TOIF)	Cost Estimate (\$)	Estimated Lead Time
<b>UID: 158827</b>		
<b><u>WFEC Heel Stone Switch Interconnection</u></b> <b>Substation:</b> Construct one 138kV line terminal, line switches, dead end structures, line relaying, communications, revenue metering, line arrestors, and all associated equipment and facilities necessary to accept transmission line from Interconnection Customer's Generating Facility.	Engineering: \$ 100,000 ROW: \$ 100,000 Material: \$ 900,000 <u>Construction: \$ 900,000</u> <b>TOTAL: \$ 2,000,000</b>	<b>60 Months</b>

Table 3: Non-Shared Network Upgrades

Non-Shared Network Upgrades Description	Cost Estimate (\$)	Estimated Lead Time
<b>UID: 158828</b>		
<b><u>WFEC Heel Stone Switch Interconnection</u></b> <b>Substation:</b> Construct 138kV three-terminal ringbus, 2000A continuous rating, 40kA short circuit rating, breakers (3), switches, foundations, overhead static, ground grid, gravel, grading, fence, line relaying and communications, acquire land, install OPGW on Hugo – Bennington line and terminate WFEC Hugo - Bennington 138kV transmission line.	Engineering: \$ 675,000 ROW: \$ 675,000 Material: \$ 6,075,000 <u>Construction: \$ 6,075,000</u> <b>TOTAL: \$ 13,500,000</b>	<b>60 Months</b>