



Report on

GEN-2025-SR30 Surplus Interconnection Service Impact Study

Revision R1 **May 7, 2026**

Submitted to
Southwest Power Pool



anedenconsulting.com

TABLE OF CONTENTS

Revision History R-1

Executive Summary ES-1

1.0 Scope of Study 1

 1.1 Reactive Power Analysis 1

 1.2 Short Circuit Analysis 1

 1.3 Stability Analysis 1

 1.4 Steady-State Analysis 1

 1.5 Necessary Interconnection Facilities & Network Upgrades 2

 1.6 Study Limitations 2

2.0 Surplus Interconnection Service Request 3

3.0 Reactive Power Analysis 6

 3.1 Methodology and Criteria 6

 3.2 Results 6

4.0 Short Circuit Analysis 8

 4.1 Methodology 8

 4.2 Results 8

5.0 Dynamic Stability Analysis 10

 5.1 Methodology and Criteria 10

 5.2 Fault Definitions 12

 5.3 Scenario 1 Results 27

 5.4 Scenario 2 Results 30

6.0 Necessary Interconnection Facilities and Network Upgrades 35

 6.1 Interconnection Facilities 35

 6.2 Network Upgrades 35

7.0 Surplus Interconnection Service Determination and Requirements 36

 7.1 Surplus Service Determination 36

 7.2 Surplus Service Requirements 36

LIST OF TABLES

Table ES-1: EGF & SGF Configuration	ES-1
Table ES-2: SGF Interconnection Configuration.....	ES-2
Table 2-1: EGF & SGF Configuration.....	3
Table 2-2: SGF Interconnection Configuration	5
Table 3-1: Shunt Reactor Size for Reactive Power Analysis.....	6
Table 4-1: Short Circuit Model Parameters*	8
Table 4-2: POI Short Circuit Comparison Results.....	8
Table 4-3: 25SP Short Circuit Comparison Results.....	9
Table 5-1: Scenario 2 Dispatch Tests	10
Table 5-2: Study Scenarios (Generator Dispatch MW)	10
Table 5-3: Fault Definitions.....	12
Table 5-4: Scenario 1 Dynamic Stability Results (EGF = 0 MW, SGF = 210.56 MW).....	27
Table 5-5: Scenario 2 Dynamic Stability Results (EGF = 167.2 MW, SGF = 43.36 MW).....	31

LIST OF FIGURES

Figure 2-1: GEN-2007-021 & GEN-2014-002 Single Line Diagram (EGF Existing Configuration*).....	4
Figure 2-2: GEN-2007-021 & GEN-2014-002 & GEN-2025-SR30 Single Line Diagram (EGF & SGF Configuration).....	4
Figure 3-1: GEN-2025-SR30 Single Line Diagram (Shunt Sizes)	7

APPENDICES

- APPENDIX A: GEN-2025-SR30 Generator Dynamic Model
- APPENDIX B: Short Circuit Results
- APPENDIX C: Dynamic Stability Results with Existing Base Case Issues & Simulation Plots

Revision History

DATE OR VERSION NUMBER	AUTHOR	CHANGE DESCRIPTION
5/7/2026	Aneden Consulting	Initial Report Issued

Executive Summary

Aneden Consulting (Aneden) was retained by the Southwest Power Pool (SPP) to perform a Surplus Interconnection Service Impact Study (Study) for GEN-2025-SR30 to utilize the Surplus Interconnection Service being made available by the combined GEN-2007-021 & GEN-2014-002 project at its existing Point of Interconnection (POI), the Tatonga 345 kV Substation in the Oklahoma Gas & Electric (OG&E) control area.

GEN-2025-SR30, the proposed Surplus Generating Facility (SGF), will connect to the existing GEN-2007-021 & GEN-2014-002 main collection substation and share its main power transformer.

GEN-2007-021 & GEN-2014-002, the Existing Generating Facility (EGF), has an effective Generator Interconnection Agreement (GIA) with a POI capacity of 209.43 MW and is making 209 MW of Surplus Interconnection Service available at its POI. Per the SPP Open Access Transmission Tariff (SPP Tariff), the amount of Surplus Interconnection Service available to the SGF is limited by the amount of Interconnection Service granted to the EGF at the same POI. In addition, the Surplus Interconnection Service is only available up to the amount that can be accommodated without requiring Network Upgrades except those specified in the SPP Tariff¹.

The proposed SGF configuration consists of 56 x Power Electronics FP4200M Battery Energy Storage System (BESS) inverters operating at 3.76 MW for a total assumed dispatch of 210.56 MW. The inverters are rated at 4.2 MVA, thus the generating capability of the SGF exceeds its requested Surplus Interconnection Service of 209 MW. The injection amount of the SGF must be limited to 209 MW at the POI. The combined generation from both the SGF and the EGF may not exceed 209.43 MW at the POI. GEN-2025-SR30 includes the use of a Power Plant Controller (PPC) to limit the power injection as required. The SGF and EGF information is shown in Table ES-1 below.

The detailed SGF configuration is captured in Table ES-2 below.

Table ES-1: EGF & SGF Configuration

Request	Interconnection Queue Capacity (MW)	Generator Fuel Type	Point of Interconnection
GEN-2025-SR30 (SGF)	209	Battery/Storage	Tatonga 345 kV (515407)
GEN-2007-021 & GEN-2014-002 (EGF)	209.43	Wind	Tatonga 345 kV (515407)

¹ Allowed Network Upgrades detailed in SPP Open Access Transmission Tariff Attachment V Section 3.3

Table ES-2: SGF Interconnection Configuration

Facility	SGF Configuration
Point of Interconnection	Tatonga 345 kV (515407)
Configuration/Capacity	56 x Power Electronics FP4200M 3.76 MW (Battery/Storage) = 210.56 MW [dispatch] Units are rated at 4.2 MVA, GEN-2025-SR30 limited to 209 MW at the POI and total POI injection w/ GEN-2007-021 & GEN-2014-002 limited to 209.43 MW
Generation Interconnection Line (Shared with the EGF and unchanged from the DISIS-2021-001 Phase 2 Models)	Length = 5.3 miles R = 0.000320 pu X = 0.002940 pu B = 0.052270 pu Rating MVA = 1019 MVA
Main Substation Transformer ¹ (Shared with the EGF and unchanged from the DISIS-2021-001 Phase 2 Models)	X12 = 8.4992% R12 = 0.1165%, X23 = 1.0997% R23 = 0.0273%, X13 = 4.6494% R13 = 0.0765%, Winding 1 MVA = 135 MVA, Winding 2 MVA = 135 MVA, Winding 3 MVA = 45 MVA, Winding 1 Rating = 225 MVA Winding 2 Rating = 225 MVA Winding 3 Rating = 75 MVA
Equivalent GSU Transformer ¹	Gen 1 Equivalent Qty: 56 X = 5.6996%, R = 0.7599%, Winding MVA = 235.2 MVA, Rating MVA = 235.2 MVA
Equivalent Collector Line ²	R = 0.000110 pu X = 0.000115 pu B = 0.002099 pu
Generator Dynamic Model ³ & Power Factor	56 x Power Electronics FP4200M 4.2 MVA (REGCA1) ³ Leading: 0.895378 Lagging: 0.895378

1) X and R based on Winding MVA, 2) All pu are on 100 MVA Base 3) DYR stability model name

SPP determined that steady-state analysis was not required because the addition of the SGF does not increase the maximum active power output of 209.43 MW. In addition, the EGF was previously studied at maximum Interconnection Service under all necessary reliability conditions.

The scope of this study included reactive power analysis, short circuit analysis, and dynamic stability analysis.

Aneden performed the analyses using the study data provided for the SGF and the DISIS-2021-001 study models:

- 2025 Summer Peak (25SP),
- 2025 Winter Peak (25WP)

All analyses were performed using the Siemens PTI PSS/E² version 34 software and the results are summarized below.

The results of the reactive power analysis using the 25SP model showed that the SGF project needed a 0.2 MVAR shunt reactor at the project substation to reduce the POI MVAR to zero when the EGF project has a shunt compensating for its charging effects. This is necessary to offset the capacitive effect on the transmission network caused by the project's transmission line and collector system during reduced generation conditions. The information gathered from the reactive power analysis is provided as information to the Interconnection Customer and Transmission Owner (TO) and/or Transmission Operator (TOP). The applicable reactive power requirements will be further reviewed by the TO and/or TOP.

The short circuit analysis was performed using the 25SP stability model modified for short circuit analysis. The results from the short circuit analysis compared the 25SP model with the EGF online and SGF not connected to the SGF study model (EGF and SGF online). The maximum contribution to three-phase fault currents in the immediate transmission systems due to the addition of the SGF was not greater than 0.26 kA. The maximum three-phase fault current level within 5 buses of the POI with the EGF and SGF generators online was 55.5 kA for the 25SP model. There were several buses with a maximum three-phase fault current over 40 kA. These buses are highlighted in Appendix B.

The dynamic stability analysis was performed using Siemens PTI PSS/E version 34.8.1 software for the two modified study models: 25SP and 25WP, each with two dispatch scenarios. 135 fault events were simulated, which included three-phase faults and single-line-to-ground stuck breaker faults.

- Scenario 1: SGF at maximum assumed dispatch, 210.56 MW, and EGF disconnected.
- Scenario 2: Aneden and SPP selected the second scenario based on a combination of SGF and EGF dispatch scenarios with the project dispatches varied by 20% increments of the EGF dispatch. The resulting selected worst-case scenario included a combination of the SGF dispatched to 43.36 MW and the EGF to 167.2 MW for a total combination of 210.56 MW.

The results of the dynamic stability analysis showed several existing base case issues that were found in both the original DISIS-2021-001 model and in the model with GEN-2025-SR30 included. These issues were not attributed to the GEN-2025-SR30 surplus request and are detailed in Appendix C.

There were no damping or voltage recovery violations attributed to the GEN-2025-SR30 surplus request observed during the simulated faults. Additionally, the project was found to stay connected during the contingencies that were studied and, therefore, will meet the Low Voltage Ride Through (LVRT) requirements of FERC Order #661A.

The results of the study showed that the Surplus Interconnection Service Request by GEN-2025-SR30 did not negatively impact the reliability of the Transmission System. There were no additional Interconnection Facilities or Network Upgrades identified by the analyses.

SPP has determined that GEN-2025-SR30 may utilize the requested 209 MW of Surplus Interconnection Service being made available by the EGF. The combined generation from both the SGF and the EGF may not exceed 209.43 MW at the POI.

² Power System Simulator for Engineering

The customer must install monitoring and control equipment as needed to ensure that the SGF does not exceed the granted surplus amount and to ensure that combination of the SGF and EGF power injected at the POI does not exceed the Interconnection Service amount listed in the EGF's GIA. The monitoring and control scheme may be reviewed by the TO and documented in Appendix C of the SGF GIA.

In accordance with FERC Order No. 827, both the SGF and EGF will be required to provide dynamic reactive power within the range of 0.95 leading to 0.95 lagging at the high-side of the generator substation.

It is likely that the customer may be required to reduce its generation output to 0 MW in real-time, also known as curtailment, under certain system conditions to allow system operators to maintain the reliability of the transmission network.

Nothing in this study should be construed as a guarantee of transmission service or delivery rights. If the customer wishes to obtain deliverability to final customers, a separate request for transmission service must be requested on Southwest Power Pool's OASIS by the customer.

1.0 Scope of Study

Aneden Consulting (Aneden) was retained by the Southwest Power Pool (SPP) to perform a Surplus Service Impact Study (Study) for GEN-2025-SR30, the Surplus Generating Facility (SGF). A Surplus Service Impact Study is performed to identify the impact of the Surplus Interconnection Service on the transmission system reliability and any additional Interconnection Facilities necessary pursuant to the SPP Generator Interconnection Procedures (“GIP”) contained in Attachment V Section 3.3 of the SPP Open Access Transmission Tariff (SPP Tariff). The amount of Surplus Interconnection Service available to the SGF is limited by the amount of Interconnection Service granted to the existing interconnection customer for the Existing Generating Facility (EGF) at the same POI. The Surplus Interconnection Service is only available up to the amount that can be accommodated without requiring additional Network Upgrades except those specified in the SPP Tariff³. The required scope of the study is dependent upon the EGF and SGF specifications. The criteria sections below include the basis of the analyses included in the scope of study.

All analyses were performed using the Siemens PTI PSS/E version 34 software. The results of each analysis are presented in the following sections.

1.1 Reactive Power Analysis

SPP requires that a reactive power analysis be performed on the requested configuration if it is a non-synchronous resource. The reactive power analysis determines the added capacitive effect at the POI caused by the project’s collection system and transmission line’s capacitance. A shunt reactor size was determined for the SGF to offset the capacitive effect and maintain zero (0) MVAR injection at the POI while the plant’s generators and capacitors were offline, and the EGF project had a shunt compensating for its charging effects.

1.2 Short Circuit Analysis

SPP requires that a short circuit analysis be performed to determine the maximum available fault current requiring interruption by protective equipment with both the SGF and EGF online, along with the amount of increase in maximum fault current due to the addition of the SGF. The analysis was performed on two scenarios, with the EGF in service and SGF offline, and the modified model with both EGF and SGF in service.

1.3 Stability Analysis

SPP requires that a dynamic stability analysis be performed to determine whether the SGF, EGF, and the transmission system will remain stable and within applicable criteria. Dynamic stability analysis was performed on two dispatch scenarios, the first where the SGF was online at 100% of the assumed dispatch with the EGF offline and disconnected, and the second which is determined to be the worst-case scenario based on a dispatch test described in Section 5.1. The stability analysis will identify any additional Interconnection Facilities and Network Upgrades necessary.

1.4 Steady-State Analysis

The steady-state (thermal/voltage) analyses may be performed as necessary to ensure that all required reliability conditions are studied. If the EGF was not studied under off-peak conditions, off-peak steady state analyses shall be performed to the required level necessary to demonstrate reliable operation of the Surplus Interconnection Service. If the original system impact study is not available for the

³ Allowed Network Upgrades detailed in SPP Open Access Transmission Tariff Attachment V Section 3.3

Interconnection Service, both off-peak and peak analysis may need to be performed for the EGF associated with the request.

An SGF that includes a fuel type (synchronous/non-synchronous) different from the EGF may require a steady-state analysis to study impacts resultant from changes in dispatch to all equal and lower queued requests. The steady-state analyses will identify any additional Interconnection Facilities and Network Upgrades necessary.

1.5 Necessary Interconnection Facilities & Network Upgrades

The SPP Tariff⁴ states that the reactive power, short circuit/fault duty, stability, and steady-state analyses (where applicable) for the Surplus Interconnection Service will identify any additional Interconnection Facilities necessary. In addition, the analyses will determine if any Network Upgrades are required for mitigation. The Surplus Interconnection Service is only available up to the amount that can be accommodated without requiring additional Network Upgrades unless (a) those additional Network Upgrades are either (1) located at the Point of Interconnection substation and at the same voltage level as the Generating Facility with an effective GIA, or (2) are System Protection Facilities; and (b) there are no material adverse impacts on the cost or timing of any Interconnection Requests pending at the time the Surplus Interconnection Service request is submitted.

1.6 Study Limitations

The assessments and conclusions provided in this report are based on assumptions and information provided to Aneden by others. While the assumptions and information provided may be appropriate for the purposes of this report, Aneden does not guarantee that those conditions assumed will occur. In addition, Aneden did not independently verify the accuracy or completeness of the information provided. As such, the conclusions and results presented in this report may vary depending on the extent to which actual future conditions differ from the assumptions made or information used herein.

⁴ SPP Open Access Transmission Tariff Section 3.3.4.1

2.0 Surplus Interconnection Service Request

The GEN-2025-SR30 Interconnection Customer has requested a Surplus Interconnection Service Impact Study (Study) for GEN-2025-SR30 to utilize the Surplus Interconnection Service being made available by the combined GEN-2007-021 & GEN-2014-002 project at its existing Point of Interconnection (POI), the Tatonga 345 kV Substation in the Oklahoma Gas & Electric (OG&E) control area.

GEN-2025-SR30, the proposed SGF, will connect to the existing GEN-2007-021 & GEN-2014-002 main collection substation and share its main power transformer.

GEN-2007-021 & GEN-2014-002, the EGF, has an effective Generation Interconnection Agreement (GIA) with a combined POI capacity of 209.43 MW and is making 209 MW of Surplus Interconnection Service available at its POI. Per the SPP Tariff the amount of Surplus Interconnection Service available to the SGF is limited by the amount of Interconnection Service granted to the EGF at the same POI. In addition, the Surplus Interconnection Service is only available up to the amount that can be accommodated without requiring additional Network Upgrades except those specified in the SPP Tariff.

At the time of the posting of this report, GEN-2007-021 & GEN-2014-002 (EGF) is an active existing generator at the same POI (Tatonga 345 kV) with a queue status of “IA FULLY EXECUTED/COMMERCIAL OPERATION”. GEN-2007-021 & GEN-2014-002 is a wind generation plant, has a combined maximum summer and winter queue capacity of 209.43 MW, and has Energy Resource Interconnection Service (ERIS). The EGF was originally studied in the ICS-2008-001 and DISIS-2014-001 cluster studies, respectively. Figure 2-1 shows the power flow model single line diagram for the EGF configuration.


The proposed SGF configuration consists of 56 x Power Electronics FP4200M Battery Energy Storage System (BESS) inverters operating at 3.76 MW for a total assumed dispatch of 210.56 MW. The inverters are rated at 4.2 MVA, thus the generating capability of the SGF exceeds its requested Surplus Interconnection Service of 209 MW. The injection amount of the SGF must be limited to 209 MW at the POI. The combined generation from both the SGF and the EGF may not exceed 209.43 MW at the POI. GEN-2025-SR30 includes the use of a Power Plant Controller (PPC) to limit the power injection as required. The SGF and EGF information is shown in Table 2-1 below.

Table 2-1: EGF & SGF Configuration

Request	Interconnection Queue Capacity (MW)	Generator Fuel Type	Point of Interconnection
GEN-2025-SR30 (SGF)	209	Battery/Storage	Tatonga 345 kV (515407)
GEN-2007-021 & GEN-2014-002 (EGF)	209.43	Wind	Tatonga 345 kV (515407)

The proposed detailed SGF configuration is captured in Figure 2-2 and Table 2-2 below.

Figure 2-1: GEN-2007-021 & GEN-2014-002 Single Line Diagram (EGF Existing Configuration*)

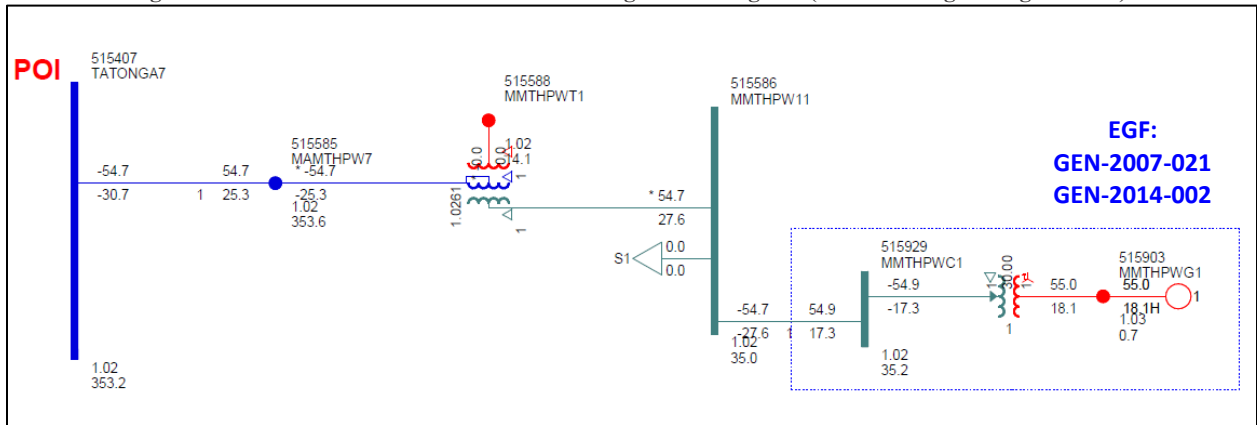

*based on the DISIS-2021-001 25SP stability models

Figure 2-2: GEN-2007-021 & GEN-2014-002 & GEN-2025-SR30 Single Line Diagram (EGF & SGF Configuration)

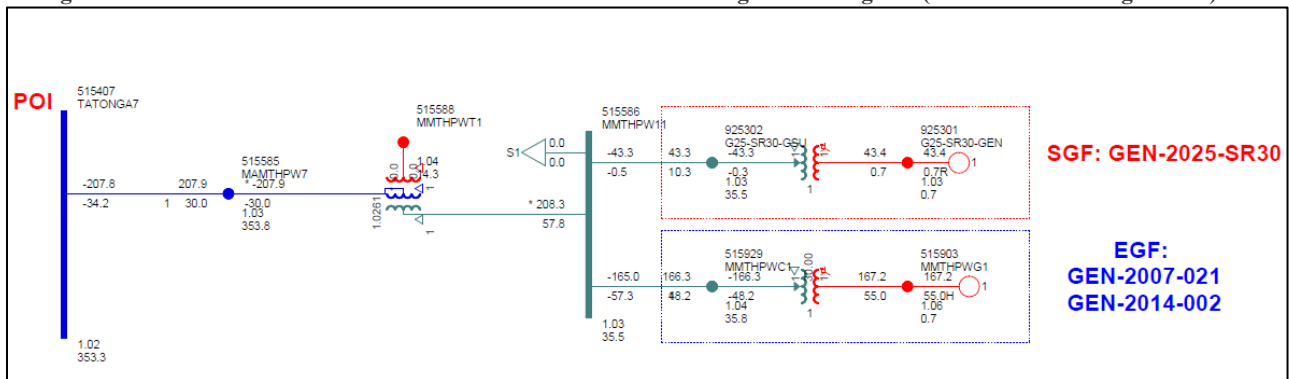


Table 2-2: SGF Interconnection Configuration

Facility	SGF Configuration
Point of Interconnection	Tatonga 345 kV (515407)
Configuration/Capacity	56 x Power Electronics FP4200M 3.76 MW (Battery/Storage) = 210.56 MW [dispatch] Units are rated at 4.2 MVA, GEN-2025-SR30 limited to 209 MW at the POI and total POI injection w/ GEN-2007-021 & GEN-2014-002 limited to 209.43 MW
Generation Interconnection Line (Shared with the EGF and unchanged from the DISIS-2021-001 Phase 2 Models)	Length = 5.3 miles R = 0.000320 pu X = 0.002940 pu B = 0.052270 pu Rating MVA = 1019 MVA
Main Substation Transformer ¹ (Shared with the EGF and unchanged from the DISIS-2021-001 Phase 2 Models)	X12 = 8.4992% R12 = 0.1165%, X23 = 1.0997% R23 = 0.0273%, X13 = 4.6494% R13 = 0.0765%, Winding 1 MVA = 135 MVA, Winding 2 MVA = 135 MVA, Winding 3 MVA = 45 MVA, Winding 1 Rating = 225 MVA Winding 2 Rating = 225 MVA Winding 3 Rating = 75 MVA
Equivalent GSU Transformer ¹	Gen 1 Equivalent Qty: 56 X = 5.6996%, R = 0.7599%, Winding MVA = 235.2 MVA, Rating MVA = 235.2 MVA
Equivalent Collector Line ²	R = 0.000110 pu X = 0.000115 pu B = 0.002099 pu
Generator Dynamic Model ³ & Power Factor	56 x Power Electronics FP4200M 4.2 MVA (REGCA1) ³ Leading: 0.895378 Lagging: 0.895378

1) X and R based on Winding MVA, 2) All pu are on 100 MVA Base 3) DYR stability model name

3.0 Reactive Power Analysis

The reactive power analysis was performed for GEN-2025-SR30 to determine the capacitive charging effects due to the SGF during reduced generation conditions (unsuitable wind speeds, unsuitable solar irradiance, insufficient state of charge, idle conditions, curtailment, etc.) at the generation site, and to size shunt reactors that would reduce the project reactive power contribution to the POI to approximately zero.

3.1 Methodology and Criteria

To determine the shunt reactor size required to compensate for the current charging attributed to the SGF collection system, the reactive power analysis for the EGF was determined first. Once the shunt size for the EGF was determined, the SGF incremental shunt reactor size was then calculated.

For each of the shunt reactor sizes calculated, all project generators and station service loads were switched offline while other collector system elements remained in-service. For the SGF reactor size calculation, the EGF generators were also switched offline. A shunt reactor was tested at the project’s collection substation 34.5 kV bus to reduce the MVar injection at the POI to zero. The size of the shunt reactor is equivalent to the charging current value at unity voltage and the compensation provided is proportional to the voltage effects on the charging current (i.e., for voltages above unity, reactive compensation is greater than the size of the reactor).

Aneden performed the reactive power analysis using the SGF data based on the 25SP DISIS-2021-001 stability study model.

3.2 Results

Per the methodology described above, the shunt size was determined for the EGF prior to calculating the shunt reactor size for the SGF. The shunt size was found to be a 15.7 MVar reactor for the EGF to reduce the MVar injection at the POI to zero. Note that the EGF shunt value is for the SGF reactive size determination only and not for sizing the predetermined EGF reactive requirements.


The results from the analysis showed that the SGF needed an approximately 0.2 MVar shunt reactor at the SGF substation, to reduce the MVar injection at the POI to zero with the pre-determined shunt for the EGF in-service. The final shunt reactor requirements are shown in Table 3-1. Figure 3-1 illustrates the shunt reactor size needed to reduce the POI MVar to approximately zero.

The information gathered from the reactive power analysis is provided as information to the Interconnection Customer and Transmission Owner (TO) and/or Transmission Operator (TOP). The applicable reactive power requirements will be further reviewed by the TO and/or TOP.

Table 3-1: Shunt Reactor Size for Reactive Power Analysis

Machine	POI Bus Number	POI Bus Name	Reactor Size (MVar)
			25SP
GEN-2025-SR30 (SGF)	515407	TATONGA7	0.2

Figure 3-1: GEN-2025-SR30 Single Line Diagram (Shunt Sizes)

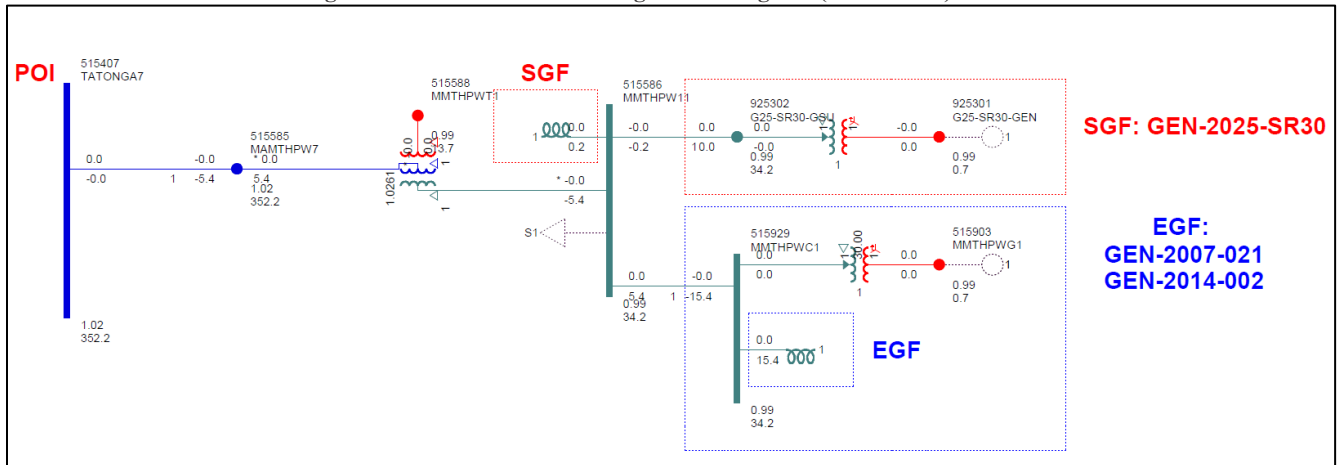

4.0 Short Circuit Analysis

A short circuit study was performed using the 25SP model to determine the maximum available fault current requiring interruption by protective equipment with both the SGF and EGF online for each bus in the relevant subsystem, and the amount of increase in maximum fault current due to the addition of the SGF. The detailed results of the short circuit analysis are provided in Appendix B.

4.1 Methodology

The short circuit analysis included applying a 3-phase fault on buses up to 5 levels away from the 345 kV POI bus. The PSS/E “Automatic Sequence Fault Calculation (ASCC)” fault analysis module was used to calculate the fault current levels in the transmission system with and without the SGF online. The first scenario was studied with both the SGF and EGF in service. In the second scenario the SGF was disconnected while the EGF was online to determine the impact of the SGF.

Aneden created a short circuit model using the 25SP DISIS-2021-001 stability study model by adjusting the SGF short circuit parameters consistent with the submitted data. The adjusted parameters used in the short circuit analysis are shown in Table 4-1 below. No other changes were made to the model.

Table 4-1: Short Circuit Model Parameters*

Parameter	Value by Generator Bus#
	925301
Machine MVA Base	235.2
R (pu)	0.0
X" (pu)	0.893

*pu values based on Machine MVA Base

4.2 Results

The results of the short circuit analysis compared the 25SP model with the EGF online and SGF not connected to the stability Scenario 2 dispatch model with both the EGF and SGF in service as described in Section 5.1. The GEN-2025-SR30 POI bus (Tatonga 345 kV) fault current magnitudes for the comparison cases are provided in Table 4-2 showing a fault current of 17.75 kA with the EGF and SGF online. The addition of the SGF configuration increased the POI bus fault current by 0.26 kA. Table 4-3 shows the maximum fault current magnitudes and fault current increases with the SGF project online.

The maximum fault current calculated within 5 buses of the POI was 55.5 kA for the 25SP model. There were several buses with a maximum three-phase fault current over 40 kA. These buses are highlighted in Appendix B. The maximum contribution to three-phase fault currents due to the addition of the SGF was about 1.5% and 0.26 kA.

Table 4-2: POI Short Circuit Comparison Results

Case	EGF Only Current (kA)	SGF & EGF Current (kA)	kA Change	%Change
25SP	17.49	17.75	0.26	1.5%

Table 4-3: 25SP Short Circuit Comparison Results

Voltage (kV)	Max. Current (EGF & SGF) (kA)	Max kA Change	Max %Change
69	11.1	0.00	0.0%
138	55.5	0.03	0.1%
230	22.3	0.00	0.0%
345	34.8	0.26	1.5%
Max	55.5	0.26	1.5%

5.0 Dynamic Stability Analysis

Aneden performed a dynamic stability analysis to identify the impact of the SGF project. The analysis was performed according to SPP's Disturbance Performance Requirements⁵. The project details are described in Section 2.0 above and the dynamic modeling data is provided in Appendix A. The existing base case issues and simulation plots can be found in Appendix C.

5.1 Methodology and Criteria

To determine the appropriate EGF/SGF dispatch combination for the second scenario (Scenario 2), dispatch models in 20% increments of the EGF dispatch were created and simulated with a POI fault. The dispatch scenarios tested are shown in Table 5-1. The nearby synchronous machine angle deviation and POI bus voltage deviation results were used to select the worst-case dispatch combination with both the EGF and SGF online for this impact study. The worst-case scenario selected is highlighted in green in the table.

Table 5-1: Scenario 2 Dispatch Tests

Dispatch Scenarios		
GEN-2007-021 & GEN-2014-002 EGF (MW)	GEN-2025-SR30 SGF (MW)	EGF + SGF (MW)
41.8	168.76	210.56
83.6	126.96	210.56
125.4	85.16	210.56
167.2	43.36	210.56

The study scenarios are shown in Table 5-2.

Table 5-2: Study Scenarios (Generator Dispatch MW)

Scenario	GEN-2007-021 & GEN-2014-002 EGF (MW)	GEN-2025-SR30 SGF (MW)	EGF + SGF (MW)
1	0 (Offline)	210.56	210.56
2	167.2	43.36	210.56

The GEN-2025-SR30 project details were used to create modified stability models for this impact study based on the DISIS-2021-001 stability study models:

- 2025 Summer Peak (25SP),
- 2025 Winter Peak (25WP)

The dynamic model data for the GEN-2025-SR30 project is provided in Appendix A. The power flow models and associated dynamic database were initialized (no-fault test) to confirm that there were no errors in the initial conditions of the system and the dynamic data.

⁵ SPP Disturbance Performance Requirements:

[https://www.spp.org/documents/28859/spp%20disturbance%20performance%20requirements%20\(twg%20approved\).pdf](https://www.spp.org/documents/28859/spp%20disturbance%20performance%20requirements%20(twg%20approved).pdf)

The following system adjustments were made to address existing base case issues that are not attributed to the surplus request:

- The PSSE dynamic simulation iterations and acceleration factors were adjusted as needed to resolve PSSE dynamic simulation crashes.

During the fault simulations, the active power (PELEC), reactive power (QELEC), and terminal voltage (ETERM) were monitored for the EGF and SGF and other current and prior queued projects in Group 4. In addition, voltages of five (5) buses away from the POI of the SGF were monitored and plotted. The machine rotor angle for synchronous machines and speed for asynchronous machines within the study areas including 327 (EES-EAI), 330 (AECD), 351 (EES), 356 (AMMO), 502 (CLEC), 515 (SWPA), 520 (AEPW), 523 (GRDA), 524 (OKGE), 525 (WFEC), 526 (SPS), 527 (OMPA), 534 (SUNC), 536 (WERE), 544 (EMDE), and 546 (SPRM) were monitored. The voltages of all 100 kV and above buses within the study area were monitored as well.

5.2 Fault Definitions

Aneden developed fault events as required to study the SGF. The new set of faults was simulated using the modified study models. The fault events included three-phase faults and single-line-to-ground stuck breaker faults. Single-line-to-ground faults are approximated by applying a fault impedance to bring the faulted bus positive sequence voltage to 0.6 pu. The simulated faults are listed and described in Table 5-3 below. These contingencies were applied to the modified 25SP and 25WP models.

Table 5-3: Fault Definitions

Fault ID	Planning Event	Fault Descriptions
FLT1000-SB	P4	Stuck Breaker on TATONGA7 (515407) 345 kV Bus a. Apply single phase fault at the TATONGA7 (515407) 345 kV Bus b. Clear fault after 16 cycles and trip the following elements: b.1. Trip the TATONGA7 (515407) 345 kV to WWRDEHV7 (515375) 345 kV line CKT 1. b.2. Trip the TATONGA7 (515407) 345 kV to SLNGWND7 (515582) 345 kV line CKT 1. Trip generator(s) on the Bus SILNGWG1 (515587) 0.7 kV Trip generator(s) on the Bus SILNGWG2 (515898) 0.7 kV
FLT1001-SB	P4	Stuck Breaker on TATONGA7 (515407) 345 kV Bus a. Apply single phase fault at the TATONGA7 (515407) 345 kV Bus b. Clear fault after 16 cycles and trip the following elements: b.1. Trip the TATONGA7 (515407) 345 kV to MATHWSN7 (515497) 345 kV line CKT 1.
FLT1002-SB	P4	Stuck Breaker on TATONGA7 (515407) 345 kV Bus a. Apply single phase fault at the TATONGA7 (515407) 345 kV Bus b. Clear fault after 16 cycles and trip the following elements: b.1. Trip the TATONGA7 (515407) 345 kV to MATHWSN7 (515497) 345 kV line CKT 2. b.2. Trip the TATONGA7 (515407) 345 kV to MAMTHPW7 (515585) 345 kV line CKT 1. Trip generator(s) on the Bus MMTHPWG1 (515903) 0.7 kV Trip generator(s) on the Bus G25-SR30-GEN (925301) 0.7 kV
FLT1003-SB	P4	Stuck Breaker on TATONGA7 (515407) 345 kV Bus a. Apply single phase fault at the TATONGA7 (515407) 345 kV Bus b. Clear fault after 16 cycles and trip the following elements: b.1. Trip the TATONGA7 (515407) 345 kV to WWRDEHV7 (515375) 345 kV line CKT 2.
FLT1004-SB	P4	Stuck Breaker on TATONGA7 (515407) 345 kV Bus a. Apply single phase fault at the TATONGA7 (515407) 345 kV Bus b. Clear fault after 16 cycles and trip the following elements: b.1. Trip the TATONGA7 (515407) 345 kV to CRSRDSW7 (515448) 345 kV line CKT 1. Trip generator(s) on the Bus CRSRDG11 (515910) 0.7 kV Trip generator(s) on the Bus CRSRDG21 (515911) 0.7 kV
FLT1005-SB	P4	Stuck Breaker on MATHWSN7 (515497) 345 kV Bus a. Apply single phase fault at the MATHWSN7 (515497) 345 kV Bus b. Clear fault after 16 cycles and trip the following elements: b.1. Trip the MATHWSN7 (515497) 345 kV to TATONGA7 (515407) 345 kV line CKT 1.
FLT1006-SB	P4	Stuck Breaker on MATHWSN7 (515497) 345 kV Bus a. Apply single phase fault at the MATHWSN7 (515497) 345 kV Bus b. Clear fault after 16 cycles and trip the following elements: b.1. Trip the MATHWSN7 (515497) 345 kV to REDNGTN7 (515875) 345 kV line CKT 1.
FLT1007-SB	P4	Stuck Breaker on MATHWSN7 (515497) 345 kV Bus a. Apply single phase fault at the MATHWSN7 (515497) 345 kV Bus b. Clear fault after 16 cycles and trip the following elements: b.1. Trip the MATHWSN7 (515497) 345 kV to CIMARON7 (514901) 345 kV line CKT 1.
FLT1008-SB	P4	Stuck Breaker on MATHWSN7 (515497) 345 kV Bus a. Apply single phase fault at the MATHWSN7 (515497) 345 kV Bus b. Clear fault after 16 cycles and trip the following elements: b.1. Trip the MATHWSN7 (515497) 345 kV to NORTWST7 (514880) 345 kV line CKT 1.
FLT1009-SB	P4	Stuck Breaker on MATHWSN7 (515497) 345 kV Bus a. Apply single phase fault at the MATHWSN7 (515497) 345 kV Bus b. Clear fault after 16 cycles and trip the following elements: b.1. Trip the MATHWSN7 (515497) 345 kV to CIMARON7 (514901) 345 kV line CKT 2.

Table 5-3 Continued

Fault ID	Planning Event	Fault Descriptions
FLT1010-SB	P4	Stuck Breaker on MATHWSN7 (515497) 345 kV Bus a. Apply single phase fault at the MATHWSN7 (515497) 345 kV Bus b. Clear fault after 16 cycles and trip the following elements: b.1. Trip the MATHWSN7 (515497) 345 kV to TATONGA7 (515407) 345 kV line CKT 2. b.2. Trip the MATHWSN7 (515497) 345 kV to TRAVERSE3 (900001) 345 kV line CKT 1. Trip generator(s) on the Bus G16-045-GEN1 (587303) 0.7 kV Trip generator(s) on the Bus G16-045-GEN2 (587307) 0.7 kV Trip generator(s) on the Bus G16-057-GEN1 (587383) 0.7 kV Trip generator(s) on the Bus G16-057-GEN2 (587387) 0.7 kV Trip generator(s) on the Bus G16-057-GEN3 (587380) 0.7 kV Trip generator(s) on the Bus G16-045-GEN3 (587300) 0.7 kV
FLT1011-SB	P4	Stuck Breaker on WWRDEHV7 (515375) 345 kV Bus a. Apply single phase fault at the WWRDEHV7 (515375) 345 kV Bus b. Clear fault after 16 cycles and trip the following elements: b.1. Trip the WWRDEHV7 (515375) 345 kV to G16-003-TAP (560071) 345 kV line CKT 1.
FLT1012-SB	P4	Stuck Breaker on WWRDEHV7 (515375) 345 kV Bus a. Apply single phase fault at the WWRDEHV7 (515375) 345 kV Bus b. Clear fault after 16 cycles and trip the following elements: b.1. Trip the WWRDEHV7 (515375) 345 kV to G16-003-TAP (560071) 345 kV line CKT 2. b.2. Trip the WWRDEHV7 (515375) 345 kV to GUTHRIE7 (515961) 345 kV line CKT 1. Trip generator(s) on the Bus GRTWSG21 (515821) 0.7 kV Trip generator(s) on the Bus GRTWSG11 (515859) 0.7 kV Trip generator(s) on the Bus PRSMNG11 (515955) 0.7 kV b.6. Trip the WWRDEHV7 (515375) 345 kV to G07621119-20 (515599) 345 kV line CKT 1. Trip generator(s) on the Bus CB_WTG1 (585423) 0.7 kV Trip generator(s) on the Bus CB_WTG2 (585426) 0.7 kV Trip generator(s) on the Bus PC2_WTG1 (585443) 0.7 kV Trip generator(s) on the Bus PC2_WTG2 (585446) 0.7 kV
FLT1013-SB	P4	Stuck Breaker on WWRDEHV7 (515375) 345 kV Bus a. Apply single phase fault at the WWRDEHV7 (515375) 345 kV Bus b. Clear fault after 16 cycles and trip the following elements: b.1. Trip the WWRDEHV7 (515375) 345 kV to BECKHAM7 (516059) 345 kV line CKT 1.
FLT1014-SB	P4	Stuck Breaker on WWRDEHV7 (515375) 345 kV Bus a. Apply single phase fault at the WWRDEHV7 (515375) 345 kV Bus b. Clear fault after 16 cycles and trip the following elements: b.1. Trip the WWRDEHV7 (515375) 345 kV to TATONGA7 (515407) 345 kV line CKT 2. b.2. Trip the WWRDEHV7 (515375) 345 kV / WWRDEHV4 (515376) 138 kV / WWDEHV31 (515795) 13.8 kV XFMR CKT 1.
FLT1015-SB	P4	Stuck Breaker on WWRDEHV7 (515375) 345 kV Bus a. Apply single phase fault at the WWRDEHV7 (515375) 345 kV Bus b. Clear fault after 16 cycles and trip the following elements: b.1. Trip the WWRDEHV7 (515375) 345 kV to TATONGA7 (515407) 345 kV line CKT 1. b.2. Trip the WWRDEHV7 (515375) 345 kV / WWRDEHV4 (515376) 138 kV / WWDEHV21 (515799) 13.8 kV XFMR CKT 2.
FLT1016-SB	P4	Stuck Breaker on WWRDEHV7 (515375) 345 kV Bus a. Apply single phase fault at the WWRDEHV7 (515375) 345 kV Bus b. Clear fault after 16 cycles and trip the following elements: b.1. Trip the WWRDEHV7 (515375) 345 kV to DGRASSE7 (515852) 345 kV line CKT 2.
FLT1017-SB	P4	Stuck Breaker on WWRDEHV7 (515375) 345 kV Bus a. Apply single phase fault at the WWRDEHV7 (515375) 345 kV Bus b. Clear fault after 16 cycles and trip the following elements: b.1. Trip the WWRDEHV7 (515375) 345 kV to DGRASSE7 (515852) 345 kV line CKT 1. b.2. Trip the WWRDEHV7 (515375) 345 kV to GEN-2019-012 (763527) 345 kV line CKT 1. Trip generator(s) on the Bus G19-012-GEN1 (763530) 0.5 kV
FLT1018-SB	P4	Stuck Breaker on WWRDEHV4 (515376) 138 kV Bus a. Apply single phase fault at the WWRDEHV4 (515376) 138 kV Bus b. Clear fault after 16 cycles and trip the following elements: b.1. Trip the WWRDEHV4 (515376) 138 kV to WWDPST 4 (515425) 138 kV line CKT 1. b.2. Trip the WWRDEHV4 (515376) 138 kV to OUSPRT 4 (515398) 138 kV line CKT 1. Trip generator(s) on the Bus OUSPRTG1 (515399) 0.7 kV

Table 5-3 Continued

Fault ID	Planning Event	Fault Descriptions
FLT1019-SB	P4	Stuck Breaker on WWRDEHV4 (515376) 138 kV Bus a. Apply single phase fault at the WWRDEHV4 (515376) 138 kV Bus b. Clear fault after 16 cycles and trip the following elements: b.1. Trip the WWRDEHV4 (515376) 138 kV to KEENAN 4 (515394) 138 kV line CKT 1. Trip generator(s) on the Bus KEENANG1 (515395) 0.7 kV
FLT1020-SB	P4	Stuck Breaker on WWRDEHV4 (515376) 138 kV Bus a. Apply single phase fault at the WWRDEHV4 (515376) 138 kV Bus b. Clear fault after 16 cycles and trip the following elements: b.1. Trip the WWRDEHV4 (515376) 138 kV / WWRDEHV7 (515375) 345 kV / WWDEHV31 (515795) 13.8 kV XFMR CKT 1.
FLT1021-SB	P4	Stuck Breaker on WWRDEHV4 (515376) 138 kV Bus a. Apply single phase fault at the WWRDEHV4 (515376) 138 kV Bus b. Clear fault after 16 cycles and trip the following elements: b.1. Trip the WWRDEHV4 (515376) 138 kV to IODINE-4 (514796) 138 kV line CKT 1. b.2. Trip the WWRDEHV4 (515376) 138 kV / WWRDEHV7 (515375) 345 kV / WWDEHV31 (515795) 13.8 kV XFMR CKT 1.
FLT9000-3PH	P1	3 Phase fault on TATONGA7 (515407) 345 kV to MAMTHPW7 (515585) 345 kV line CKT 1, near TATONGA7 (515407) 345 kV. a. Apply fault at the TATONGA7 (515407) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus MMTHPWG1 (515903) 0.7 kV Trip generator(s) on the Bus G25-SR30-GEN (925301) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9001-3PH	P1	3 Phase fault on TATONGA7 (515407) 345 kV to CRSRDSW7 (515448) 345 kV line CKT 1, near TATONGA7 (515407) 345 kV. a. Apply fault at the TATONGA7 (515407) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus CRSRDG11 (515910) 0.7 kV Trip generator(s) on the Bus CRSRDG21 (515911) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9002-3PH	P1	3 Phase fault on TATONGA7 (515407) 345 kV to WWRDEHV7 (515375) 345 kV line CKT 2, near TATONGA7 (515407) 345 kV. a. Apply fault at the TATONGA7 (515407) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9003-3PH	P1	3 Phase fault on WWRDEHV7 (515375) 345 kV to TATONGA7 (515407) 345 kV line CKT 2, near WWRDEHV7 (515375) 345 kV. a. Apply fault at the WWRDEHV7 (515375) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9004-3PH	P1	3 Phase fault on WWRDEHV7 (515375) 345 kV to DGRASSE7 (515852) 345 kV line CKT 1, near WWRDEHV7 (515375) 345 kV. a. Apply fault at the WWRDEHV7 (515375) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9005-3PH	P1	3 Phase fault on DGRASSE7 (515852) 345 kV to WWRDEHV7 (515375) 345 kV line CKT 1, near DGRASSE7 (515852) 345 kV. a. Apply fault at the DGRASSE7 (515852) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9006-3PH	P1	3 Phase fault on DGRASSE7 (515852) 345 kV to THISTLE7 (539801) 345 kV line CKT 2, near DGRASSE7 (515852) 345 kV. a. Apply fault at the DGRASSE7 (515852) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.

Table 5-3 Continued

Fault ID	Planning Event	Fault Descriptions
FLT9007-3PH	P1	3 Phase fault on DGRASSE7 (515852) 345 kV / DGRASSE4 (515853) 138 kV / DGRASSE1 (515854) 13.8 kV XFMR CKT 1, near DGRASSE7 (515852) 345 kV. a. Apply fault at the DGRASSE7 (515852) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted transformer.
FLT9008-3PH	P1	3 Phase fault on DGRASSE4 (515853) 138 kV / DGRASSE7 (515852) 345 kV / DGRASSE1 (515854) 13.8 kV XFMR CKT 1, near DGRASSE4 (515853) 138 kV. a. Apply fault at the DGRASSE4 (515853) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted transformer.
FLT9009-3PH	P1	3 Phase fault on DGRASSE4 (515853) 138 kV to KNOBHIL4 (514795) 138 kV line CKT 1, near DGRASSE4 (515853) 138 kV. a. Apply fault at the DGRASSE4 (515853) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9010-3PH	P1	3 Phase fault on DGRASSE4 (515853) 138 kV to ROSEVLY4 (520436) 138 kV line CKT 1, near DGRASSE4 (515853) 138 kV. a. Apply fault at the DGRASSE4 (515853) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9011-3PH	P1	3 Phase fault on DGRASSE4 (515853) 138 kV to MOORLND4 (520999) 138 kV line CKT 1, near DGRASSE4 (515853) 138 kV. a. Apply fault at the DGRASSE4 (515853) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9012-3PH	P1	3 Phase fault on DGRASSE4 (515853) 138 kV to GEN-2019-045 (763769) 138 kV line CKT 1, near DGRASSE4 (515853) 138 kV. a. Apply fault at the DGRASSE4 (515853) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Trip generator(s) on the Bus G19-045-GEN1 (763772) 0.7 kV d. Wait 20 cycles, and then re-close the line in (b) back into the fault. e. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9013-3PH	P1	3 Phase fault on WWRDEHV7 (515375) 345 kV to BECKHAM7 (516059) 345 kV line CKT 1, near WWRDEHV7 (515375) 345 kV. a. Apply fault at the WWRDEHV7 (515375) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9014-3PH	P1	3 Phase fault on BECKHAM7 (516059) 345 kV to WWRDEHV7 (515375) 345 kV line CKT 1, near BECKHAM7 (516059) 345 kV. a. Apply fault at the BECKHAM7 (516059) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9015-3PH	P1	3 Phase fault on BECKHAM7 (516059) 345 kV to CHISHOLM7 (511553) 345 kV line CKT 1, near BECKHAM7 (516059) 345 kV. a. Apply fault at the BECKHAM7 (516059) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9016-3PH	P1	3 Phase fault on BECKHAM7 (516059) 345 kV to BORDER 7 (515458) 345 kV line CKT 1, near BECKHAM7 (516059) 345 kV. a. Apply fault at the BECKHAM7 (516059) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.

Table 5-3 Continued

Fault ID	Planning Event	Fault Descriptions
FLT9017-3PH	P1	3 Phase fault on WWRDEHV7 (515375) 345 kV to GUTHRIE7 (515961) 345 kV line CKT 1, near WWRDEHV7 (515375) 345 kV. a. Apply fault at the WWRDEHV7 (515375) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus GRTWSG21 (515821) 0.7 kV Trip generator(s) on the Bus GRTWSG11 (515859) 0.7 kV Trip generator(s) on the Bus PRSMNG11 (515955) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9018-3PH	P1	3 Phase fault on GUTHRIE7 (515961) 345 kV to WWRDEHV7 (515375) 345 kV line CKT 1, near GUTHRIE7 (515961) 345 kV. a. Apply fault at the GUTHRIE7 (515961) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus GRTWSG21 (515821) 0.7 kV Trip generator(s) on the Bus GRTWSG11 (515859) 0.7 kV Trip generator(s) on the Bus PRSMNG11 (515955) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9019-3PH	P1	3 Phase fault on GUTHRIE7 (515961) 345 kV to GRTWSRN7 (515825) 345 kV line CKT 1, near GUTHRIE7 (515961) 345 kV. a. Apply fault at the GUTHRIE7 (515961) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus GRTWSG21 (515821) 0.7 kV Trip generator(s) on the Bus GRTWSG11 (515859) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9020-3PH	P1	3 Phase fault on GUTHRIE7 (515961) 345 kV to PERSIMN7 (515951) 345 kV line CKT 1, near GUTHRIE7 (515961) 345 kV. a. Apply fault at the GUTHRIE7 (515961) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus PRSMNG11 (515955) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9021-3PH	P1	3 Phase fault on WWRDEHV7 (515375) 345 kV to G16-003-TAP (560071) 345 kV line CKT 1, near WWRDEHV7 (515375) 345 kV. a. Apply fault at the WWRDEHV7 (515375) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9022-3PH	P1	3 Phase fault on G16-003-TAP (560071) 345 kV to WWRDEHV7 (515375) 345 kV line CKT 1, near G16-003-TAP (560071) 345 kV. a. Apply fault at the G16-003-TAP (560071) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9023-3PH	P1	3 Phase fault on G16-003-TAP (560071) 345 kV to BADGER 7 (515677) 345 kV line CKT 1, near G16-003-TAP (560071) 345 kV. a. Apply fault at the G16-003-TAP (560071) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9024-3PH	P1	3 Phase fault on G16-003-TAP (560071) 345 kV to GEN-2016-003 (587020) 345 kV line CKT 1, near G16-003-TAP (560071) 345 kV. a. Apply fault at the G16-003-TAP (560071) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus G16-003-GEN1 (587023) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.

Table 5-3 Continued

Fault ID	Planning Event	Fault Descriptions
FLT9025-3PH	P1	3 Phase fault on G16-003-TAP (560071) 345 kV to GEN-2017-011 (588560) 345 kV line CKT 1, near G16-003-TAP (560071) 345 kV. a. Apply fault at the G16-003-TAP (560071) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus G17-011-GEN1 (588563) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9026-3PH	P1	3 Phase fault on G16-003-TAP (560071) 345 kV to GEN-2021-015 (765440) 345 kV line CKT 1, near G16-003-TAP (560071) 345 kV. a. Apply fault at the G16-003-TAP (560071) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus G21-015-GEN1 (765442) 0.6 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9027-3PH	P1	3 Phase fault on G16-003-TAP (560071) 345 kV to 25MILE 7 (516146) 345 kV line CKT 1, near G16-003-TAP (560071) 345 kV. a. Apply fault at the G16-003-TAP (560071) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus 25MILG11 (516150) 0.7 kV Trip generator(s) on the Bus 25MILG21 (516151) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9028-3PH	P1	3 Phase fault on WWRDEHV7 (515375) 345 kV / WWRDEHV4 (515376) 138 kV / WWDEHV21 (515799) 13.8 kV XFMR CKT 2, near WWRDEHV7 (515375) 345 kV. a. Apply fault at the WWRDEHV7 (515375) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted transformer.
FLT9029-3PH	P1	3 Phase fault on WWRDEHV4 (515376) 138 kV / WWRDEHV7 (515375) 345 kV / WWDEHV21 (515799) 13.8 kV XFMR CKT 2, near WWRDEHV4 (515376) 138 kV. a. Apply fault at the WWRDEHV4 (515376) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted transformer.
FLT9030-3PH	P1	3 Phase fault on WWRDEHV4 (515376) 138 kV to WWDPST 4 (515425) 138 kV line CKT 1, near WWRDEHV4 (515376) 138 kV. a. Apply fault at the WWRDEHV4 (515376) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9031-3PH	P1	3 Phase fault on WWDPST 4 (515425) 138 kV to WWRDEHV4 (515376) 138 kV line CKT 1, near WWDPST 4 (515425) 138 kV. a. Apply fault at the WWDPST 4 (515425) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9032-3PH	P1	3 Phase fault on WWDPST 4 (515425) 138 kV to WOODWRD4 (514785) 138 kV XFMR CKT 1, near WWDPST 4 (515425) 138 kV. a. Apply fault at the WWDPST 4 (515425) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted transformer.
FLT9033-3PH	P1	3 Phase fault on WWRDEHV4 (515376) 138 kV to KEENAN 4 (515394) 138 kV line CKT 1, near WWRDEHV4 (515376) 138 kV. a. Apply fault at the WWRDEHV4 (515376) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. Trip generator(s) on the Bus KEENANG1 (515395) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9034-3PH	P1	3 Phase fault on WWRDEHV4 (515376) 138 kV to OUSPRT 4 (515398) 138 kV line CKT 1, near WWRDEHV4 (515376) 138 kV. a. Apply fault at the WWRDEHV4 (515376) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. Trip generator(s) on the Bus OUSPRTG1 (515399) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.

Table 5-3 Continued

Fault ID	Planning Event	Fault Descriptions
FLT9035-3PH	P1	3 Phase fault on WWRDEHV4 (515376) 138 kV to IODINE-4 (514796) 138 kV line CKT 1, near WWRDEHV4 (515376) 138 kV. a. Apply fault at the WWRDEHV4 (515376) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9036-3PH	P1	3 Phase fault on IODINE-4 (514796) 138 kV to WWRDEHV4 (515376) 138 kV line CKT 1, near IODINE-4 (514796) 138 kV. a. Apply fault at the IODINE-4 (514796) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9037-3PH	P1	3 Phase fault on IODINE-4 (514796) 138 kV to REDCLFT4 (515533) 138 kV line CKT 1, near IODINE-4 (514796) 138 kV. a. Apply fault at the IODINE-4 (514796) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9038-3PH	P1	3 Phase fault on TATONGA7 (515407) 345 kV to SLNGWND7 (515582) 345 kV line CKT 1, near TATONGA7 (515407) 345 kV. a. Apply fault at the TATONGA7 (515407) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus SILNGWG1 (515587) 0.7 kV Trip generator(s) on the Bus SILNGWG2 (515898) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9039-3PH	P1	3 Phase fault on TATONGA7 (515407) 345 kV to MATHWSN7 (515497) 345 kV line CKT 1, near TATONGA7 (515407) 345 kV. a. Apply fault at the TATONGA7 (515407) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9040-3PH	P1	3 Phase fault on MATHWSN7 (515497) 345 kV to TATONGA7 (515407) 345 kV line CKT 1, near MATHWSN7 (515497) 345 kV. a. Apply fault at the MATHWSN7 (515497) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9041-3PH	P1	3 Phase fault on MATHWSN7 (515497) 345 kV to TRAVERSE3 (900001) 345 kV line CKT 1, near MATHWSN7 (515497) 345 kV. a. Apply fault at the MATHWSN7 (515497) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus G16-045-GEN1 (587303) 0.7 kV Trip generator(s) on the Bus G16-045-GEN2 (587307) 0.7 kV Trip generator(s) on the Bus G16-057-GEN1 (587383) 0.7 kV Trip generator(s) on the Bus G16-057-GEN2 (587387) 0.7 kV Trip generator(s) on the Bus G16-045-GEN3 (587300) 0.7 kV Trip generator(s) on the Bus G16-057-GEN3 (587380) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9042-3PH	P1	3 Phase fault on MATHWSN7 (515497) 345 kV to REDNGTN7 (515875) 345 kV line CKT 1, near MATHWSN7 (515497) 345 kV. a. Apply fault at the MATHWSN7 (515497) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9043-3PH	P1	3 Phase fault on REDNGTN7 (515875) 345 kV to MATHWSN7 (515497) 345 kV line CKT 1, near REDNGTN7 (515875) 345 kV. a. Apply fault at the REDNGTN7 (515875) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.

Table 5-3 Continued

Fault ID	Planning Event	Fault Descriptions
FLT9044-3PH	P1	3 Phase fault on REDNGTN7 (515875) 345 kV to REDDIRT7 (515877) 345 kV line CKT Z1, near REDNGTN7 (515875) 345 kV. a. Apply fault at the REDNGTN7 (515875) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus RDDRTG11 (515882) 12 kV Trip generator(s) on the Bus RDDRTG21 (515883) 12 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9045-3PH	P1	3 Phase fault on REDNGTN7 (515875) 345 kV to WOODRNG7 (514715) 345 kV line CKT 1, near REDNGTN7 (515875) 345 kV. a. Apply fault at the REDNGTN7 (515875) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9046-3PH	P1	3 Phase fault on WWRDEHV7 (515375) 345 kV to GEN-2019-012 (763527) 345 kV line CKT 1, near WWRDEHV7 (515375) 345 kV. a. Apply fault at the WWRDEHV7 (515375) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus G19-012-GEN1 (763530) 0.5 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9048-3PH	P1	3 Phase fault on MATHWSN7 (515497) 345 kV to CIMARON7 (514901) 345 kV line CKT 1, near MATHWSN7 (515497) 345 kV. a. Apply fault at the MATHWSN7 (515497) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9049-3PH	P1	3 Phase fault on CIMARON7 (514901) 345 kV to MATHWSN7 (515497) 345 kV line CKT 1, near CIMARON7 (514901) 345 kV. a. Apply fault at the CIMARON7 (514901) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9050-3PH	P1	3 Phase fault on CIMARON7 (514901) 345 kV / CIMARON4 (514898) 138 kV / CIMARO11 (515714) 13.8 kV XFMR CKT 1, near CIMARON7 (514901) 345 kV. a. Apply fault at the CIMARON7 (514901) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted transformer.
FLT9051-3PH	P1	3 Phase fault on CIMARON4 (514898) 138 kV / CIMARON7 (514901) 345 kV / CIMARO11 (515714) 13.8 kV XFMR CKT 1, near CIMARON4 (514898) 138 kV. a. Apply fault at the CIMARON4 (514898) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted transformer.
FLT9052-3PH	P1	3 Phase fault on CIMARON4 (514898) 138 kV to HAYMAKR4 (514863) 138 kV line CKT 1, near CIMARON4 (514898) 138 kV. a. Apply fault at the CIMARON4 (514898) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9053-3PH	P1	3 Phase fault on CIMARON4 (514898) 138 kV to SARA 4 (514895) 138 kV line CKT 1, near CIMARON4 (514898) 138 kV. a. Apply fault at the CIMARON4 (514898) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9054-3PH	P1	3 Phase fault on CIMARON4 (514898) 138 kV to JENSENT4 (514820) 138 kV line CKT 1, near CIMARON4 (514898) 138 kV. a. Apply fault at the CIMARON4 (514898) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.

Table 5-3 Continued

Fault ID	Planning Event	Fault Descriptions
FLT9055-3PH	P1	3 Phase fault on CIMARON4 (514898) 138 kV to EL-RENO4 (514819) 138 kV line CKT 1, near CIMARON4 (514898) 138 kV. a. Apply fault at the CIMARON4 (514898) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9056-3PH	P1	3 Phase fault on CIMARON4 (514898) 138 kV to CZECHAL4 (514894) 138 kV line CKT 1, near CIMARON4 (514898) 138 kV. a. Apply fault at the CIMARON4 (514898) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9057-3PH	P1	3 Phase fault on CIMARON4 (514898) 138 kV to TUTCONT4 (511425) 138 kV line CKT 1, near CIMARON4 (514898) 138 kV. a. Apply fault at the CIMARON4 (514898) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9058-3PH	P1	3 Phase fault on CIMARON7 (514901) 345 kV to FSHRTAP7 (515610) 345 kV line CKT 1, near CIMARON7 (514901) 345 kV. a. Apply fault at the CIMARON7 (514901) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus KNGFSHR-GEN1 (515664) 0.7 kV Trip generator(s) on the Bus KNGFSHR-GEN2 (515665) 0.7 kV Trip generator(s) on the Bus CANADNG1 (515900) 0.7 kV Trip generator(s) on the Bus CANADNG2 (515902) 0.6 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9059-3PH	P1	3 Phase fault on CIMARON7 (514901) 345 kV to MINCO 7 (514801) 345 kV line CKT 1, near CIMARON7 (514901) 345 kV. a. Apply fault at the CIMARON7 (514901) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9060-3PH	P1	3 Phase fault on CIMARON7 (514901) 345 kV to NORMHLL7 (516096) 345 kV line CKT 1, near CIMARON7 (514901) 345 kV. a. Apply fault at the CIMARON7 (514901) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9061-3PH	P1	3 Phase fault on MATHWSN7 (515497) 345 kV to NORTWST7 (514880) 345 kV line CKT 1, near MATHWSN7 (515497) 345 kV. a. Apply fault at the MATHWSN7 (515497) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9062-3PH	P1	3 Phase fault on NORTWST7 (514880) 345 kV to MATHWSN7 (515497) 345 kV line CKT 1, near NORTWST7 (514880) 345 kV. a. Apply fault at the NORTWST7 (514880) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9063-3PH	P1	3 Phase fault on NORTWST7 (514880) 345 kV to CIMARON7 (514901) 345 kV line CKT 1, near NORTWST7 (514880) 345 kV. a. Apply fault at the NORTWST7 (514880) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.

Table 5-3 Continued

Fault ID	Planning Event	Fault Descriptions
FLT9064-3PH	P1	3 Phase fault on CIMARON7 (514901) 345 kV to NORTWST7 (514880) 345 kV line CKT 1, near CIMARON7 (514901) 345 kV. a. Apply fault at the CIMARON7 (514901) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9065-3PH	P1	3 Phase fault on NORTWST7 (514880) 345 kV to SPRNGCK7 (514881) 345 kV line CKT 1, near NORTWST7 (514880) 345 kV. a. Apply fault at the NORTWST7 (514880) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9066-3PH	P1	3 Phase fault on NORTWST7 (514880) 345 kV to ARCADIA7 (514908) 345 kV line CKT 1, near NORTWST7 (514880) 345 kV. a. Apply fault at the NORTWST7 (514880) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9067-3PH	P1	3 Phase fault on NORTWST4 (514879) 138 kV / NORTWST4 (514879) 138 kV / NORTWS21 (515742) 13.8 kV XFMR CKT 1, near NORTWST7 (514880) 345 kV. a. Apply fault at the NORTWST7 (514880) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted transformer.
FLT9068-3PH	P1	3 Phase fault on NORTWST4 (514879) 138 kV / NORTWST7 (514880) 345 kV / NORTWS21 (515742) 13.8 kV XFMR CKT 1, near NORTWST4 (514879) 138 kV. a. Apply fault at the NORTWST4 (514879) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted transformer.
FLT9069-3PH	P1	3 Phase fault on NORTWST4 (514879) 138 kV to KETCHTP4 (514828) 138 kV line CKT 1, near NORTWST4 (514879) 138 kV. a. Apply fault at the NORTWST4 (514879) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9070-3PH	P1	3 Phase fault on NORTWST4 (514879) 138 kV to PIEDMNT4 (514864) 138 kV line CKT 1, near NORTWST4 (514879) 138 kV. a. Apply fault at the NORTWST4 (514879) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9071-3PH	P1	3 Phase fault on NORTWST4 (514879) 138 kV to LNEOAK 4 (514873) 138 kV line CKT 1, near NORTWST4 (514879) 138 kV. a. Apply fault at the NORTWST4 (514879) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9072-3PH	P1	3 Phase fault on NORTWST4 (514879) 138 kV to BRADEN 4 (514854) 138 kV line CKT 1, near NORTWST4 (514879) 138 kV. a. Apply fault at the NORTWST4 (514879) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9073-3PH	P1	3 Phase fault on KEENAN 4 (515394) 138 kV to WWRDEHV4 (515376) 138 kV line CKT 1, near KEENAN 4 (515394) 138 kV. a. Apply fault at the KEENAN 4 (515394) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. Trip generator(s) on the Bus KEENANG1 (515395) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.

Table 5-3 Continued

Fault ID	Planning Event	Fault Descriptions
FLT9074-3PH	P1	3 Phase fault on OUSPRT 4 (515398) 138 kV to WWRDEHV4 (515376) 138 kV line CKT 1, near OUSPRT 4 (515398) 138 kV. a. Apply fault at the OUSPRT 4 (515398) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. Trip generator(s) on the Bus OUSPRTG1 (515399) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9075-3PH	P1	3 Phase fault on SLNGWND7 (515582) 345 kV to TATONGA7 (515407) 345 kV line CKT 1, near SLNGWND7 (515582) 345 kV. a. Apply fault at the SLNGWND7 (515582) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus SILNGWG1 (515587) 0.7 kV Trip generator(s) on the Bus SILNGWG2 (515898) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9076-3PH	P1	3 Phase fault on TRAVERSE3 (900001) 345 kV to MATHWSN7 (515497) 345 kV line CKT 1, near TRAVERSE3 (900001) 345 kV. a. Apply fault at the TRAVERSE3 (900001) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus G16-045-GEN1 (587303) 0.7 kV Trip generator(s) on the Bus G16-045-GEN2 (587307) 0.7 kV Trip generator(s) on the Bus G16-057-GEN1 (587383) 0.7 kV Trip generator(s) on the Bus G16-057-GEN2 (587387) 0.7 kV Trip generator(s) on the Bus G16-045-GEN3 (587300) 0.7 kV Trip generator(s) on the Bus G16-057-GEN3 (587380) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9077-3PH	P1	3 Phase fault on GEN-2019-012 (763527) 345 kV to WWRDEHV7 (515375) 345 kV line CKT 1, near GEN-2019-012 (763527) 345 kV. a. Apply fault at the GEN-2019-012 (763527) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus G19-012-GEN1 (763530) 0.5 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9078-3PH	P1	3 Phase fault on MAMTHPW7 (515585) 345 kV to TATONGA7 (515407) 345 kV line CKT 1, near MAMTHPW7 (515585) 345 kV. a. Apply fault at the MAMTHPW7 (515585) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus MMTHPWG1 (515903) 0.7 kV Trip generator(s) on the Bus G25-SR30-GEN (925301) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9079-3PH	P1	3 Phase fault on CRSRDSW7 (515448) 345 kV to TATONGA7 (515407) 345 kV line CKT 1, near CRSRDSW7 (515448) 345 kV. a. Apply fault at the CRSRDSW7 (515448) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus CRSRDG11 (515910) 0.7 kV Trip generator(s) on the Bus CRSRDG21 (515911) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9080-3PH	P1	3 Phase fault on THISTLE7 (539801) 345 kV to DGRASSE7 (515852) 345 kV line CKT 2, near THISTLE7 (539801) 345 kV. a. Apply fault at the THISTLE7 (539801) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9081-3PH	P1	3 Phase fault on KNOBHIL4 (514795) 138 kV to DGRASSE4 (515853) 138 kV line CKT 1, near KNOBHIL4 (514795) 138 kV. a. Apply fault at the KNOBHIL4 (514795) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.

Table 5-3 Continued

Fault ID	Planning Event	Fault Descriptions
FLT9082-3PH	P1	3 Phase fault on ROSEVLY4 (520436) 138 kV to DGRASSE4 (515853) 138 kV line CKT 1, near ROSEVLY4 (520436) 138 kV. a. Apply fault at the ROSEVLY4 (520436) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9083-3PH	P1	3 Phase fault on MOORLND4 (520999) 138 kV to DGRASSE4 (515853) 138 kV line CKT 1, near MOORLND4 (520999) 138 kV. a. Apply fault at the MOORLND4 (520999) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9084-3PH	P1	3 Phase fault on GEN-2019-045 (763769) 138 kV to DGRASSE4 (515853) 138 kV line CKT 1, near GEN-2019-045 (763769) 138 kV. a. Apply fault at the GEN-2019-045 (763769) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. Trip generator(s) on the Bus G19-045-GEN1 (763772) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9085-3PH	P1	3 Phase fault on CHISHOLM7 (511553) 345 kV to BECKHAM7 (516059) 345 kV line CKT 1, near CHISHOLM7 (511553) 345 kV. a. Apply fault at the CHISHOLM7 (511553) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9086-3PH	P1	3 Phase fault on BORDER 7 (515458) 345 kV to BECKHAM7 (516059) 345 kV line CKT 1, near BORDER 7 (515458) 345 kV. a. Apply fault at the BORDER 7 (515458) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9087-3PH	P1	3 Phase fault on GRTWSRN7 (515825) 345 kV to GUTHRIE7 (515961) 345 kV line CKT 1, near GRTWSRN7 (515825) 345 kV. a. Apply fault at the GRTWSRN7 (515825) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus GRTWSG21 (515821) 0.7 kV Trip generator(s) on the Bus GRTWSG11 (515859) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9088-3PH	P1	3 Phase fault on PERSIMN7 (515951) 345 kV to GUTHRIE7 (515961) 345 kV line CKT 1, near PERSIMN7 (515951) 345 kV. a. Apply fault at the PERSIMN7 (515951) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus PRSMNG11 (515955) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9089-3PH	P1	3 Phase fault on BADGER 7 (515677) 345 kV to G16-003-TAP (560071) 345 kV line CKT 1, near BADGER 7 (515677) 345 kV. a. Apply fault at the BADGER 7 (515677) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9090-3PH	P1	3 Phase fault on GEN-2016-003 (587020) 345 kV to G16-003-TAP (560071) 345 kV line CKT 1, near GEN-2016-003 (587020) 345 kV. a. Apply fault at the GEN-2016-003 (587020) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus G16-003-GEN1 (587023) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.

Table 5-3 Continued

Fault ID	Planning Event	Fault Descriptions
FLT9091-3PH	P1	3 Phase fault on GEN-2017-011 (588560) 345 kV to G16-003-TAP (560071) 345 kV line CKT 1, near GEN-2017-011 (588560) 345 kV. a. Apply fault at the GEN-2017-011 (588560) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus G17-011-GEN1 (588563) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9092-3PH	P1	3 Phase fault on GEN-2021-015 (765440) 345 kV to G16-003-TAP (560071) 345 kV line CKT 1, near GEN-2021-015 (765440) 345 kV. a. Apply fault at the GEN-2021-015 (765440) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus G21-015-GEN1 (765442) 0.6 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9093-3PH	P1	3 Phase fault on 25MILE 7 (516146) 345 kV to G16-003-TAP (560071) 345 kV line CKT 1, near 25MILE 7 (516146) 345 kV. a. Apply fault at the 25MILE 7 (516146) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus 25MILG11 (516150) 0.7 kV Trip generator(s) on the Bus 25MILG21 (516151) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9094-3PH	P1	3 Phase fault on WOODWRD4 (514785) 138 kV to WWDPT 4 (515425) 138 kV XFMR CKT 1, near WOODWRD4 (514785) 138 kV. a. Apply fault at the WOODWRD4 (514785) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted transformer.
FLT9095-3PH	P1	3 Phase fault on REDCLFT4 (515533) 138 kV to IODINE-4 (514796) 138 kV line CKT 1, near REDCLFT4 (515533) 138 kV. a. Apply fault at the REDCLFT4 (515533) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9096-3PH	P1	3 Phase fault on TRAVERSE3 (900001) 345 kV to TRW2-TRW3 (900004) 345 kV line CKT 1, near TRAVERSE3 (900001) 345 kV. a. Apply fault at the TRAVERSE3 (900001) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus G16-057-GEN1 (587383) 0.7 kV Trip generator(s) on the Bus G16-057-GEN2 (587387) 0.7 kV Trip generator(s) on the Bus G16-045-GEN3 (587300) 0.7 kV Trip generator(s) on the Bus G16-057-GEN3 (587380) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9097-3PH	P1	3 Phase fault on TRW2-TRW3 (900004) 345 kV to TRAVERSE3 (900001) 345 kV line CKT 1, near TRW2-TRW3 (900004) 345 kV. a. Apply fault at the TRW2-TRW3 (900004) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus G16-057-GEN1 (587383) 0.7 kV Trip generator(s) on the Bus G16-057-GEN2 (587387) 0.7 kV Trip generator(s) on the Bus G16-045-GEN3 (587300) 0.7 kV Trip generator(s) on the Bus G16-057-GEN3 (587380) 0.7 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9099-3PH	P1	3 Phase fault on WOODRNG7 (514715) 345 kV to REDNGTN7 (515875) 345 kV line CKT 1, near WOODRNG7 (514715) 345 kV. a. Apply fault at the WOODRNG7 (514715) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.

Table 5-3 Continued

Fault ID	Planning Event	Fault Descriptions
FLT9100-3PH	P1	3 Phase fault on HAYMAKR4 (514863) 138 kV to CIMARON4 (514898) 138 kV line CKT 1, near HAYMAKR4 (514863) 138 kV. a. Apply fault at the HAYMAKR4 (514863) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9101-3PH	P1	3 Phase fault on SARA 4 (514895) 138 kV to CIMARON4 (514898) 138 kV line CKT 1, near SARA 4 (514895) 138 kV. a. Apply fault at the SARA 4 (514895) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9102-3PH	P1	3 Phase fault on JENSENT4 (514820) 138 kV to CIMARON4 (514898) 138 kV line CKT 1, near JENSENT4 (514820) 138 kV. a. Apply fault at the JENSENT4 (514820) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9103-3PH	P1	3 Phase fault on EL-RENO4 (514819) 138 kV to CIMARON4 (514898) 138 kV line CKT 1, near EL-RENO4 (514819) 138 kV. a. Apply fault at the EL-RENO4 (514819) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9104-3PH	P1	3 Phase fault on CZECHAL4 (514894) 138 kV to CIMARON4 (514898) 138 kV line CKT 1, near CZECHAL4 (514894) 138 kV. a. Apply fault at the CZECHAL4 (514894) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9105-3PH	P1	3 Phase fault on TUTCONT4 (511425) 138 kV to CIMARON4 (514898) 138 kV line CKT 1, near TUTCONT4 (511425) 138 kV. a. Apply fault at the TUTCONT4 (511425) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9106-3PH	P1	3 Phase fault on FSHRTAP7 (515610) 345 kV to CIMARON7 (514901) 345 kV line CKT 1, near FSHRTAP7 (515610) 345 kV. a. Apply fault at the FSHRTAP7 (515610) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. Trip generator(s) on the Bus KNGFSHR-GEN1 (515664) 0.7 kV Trip generator(s) on the Bus KNGFSHR-GEN1 (515664) 0.7 kV Trip generator(s) on the Bus KNGFSHR-GEN2 (515665) 0.7 kV Trip generator(s) on the Bus CANADNG1 (515900) 0.7 kV Trip generator(s) on the Bus CANADNG2 (515902) 0.6 kV c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9107-3PH	P1	3 Phase fault on MINCO 7 (514801) 345 kV to CIMARON7 (514901) 345 kV line CKT 1, near MINCO 7 (514801) 345 kV. a. Apply fault at the MINCO 7 (514801) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9108-3PH	P1	3 Phase fault on NORMHLL7 (516096) 345 kV to CIMARON7 (514901) 345 kV line CKT 1, near NORMHLL7 (516096) 345 kV. a. Apply fault at the NORMHLL7 (516096) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.

Table 5-3 Continued

Fault ID	Planning Event	Fault Descriptions
FLT9109-3PH	P1	3 Phase fault on SPRNGCK7 (514881) 345 kV to NORTWST7 (514880) 345 kV line CKT 1, near SPRNGCK7 (514881) 345 kV. a. Apply fault at the SPRNGCK7 (514881) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9110-3PH	P1	3 Phase fault on ARCADIA7 (514908) 345 kV to NORTWST7 (514880) 345 kV line CKT 1, near ARCADIA7 (514908) 345 kV. a. Apply fault at the ARCADIA7 (514908) 345 kV Bus. b. Clear fault after 6 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 6 cycles, then trip the line in (b) and remove fault.
FLT9111-3PH	P1	3 Phase fault on KETCHTP4 (514828) 138 kV to NORTWST4 (514879) 138 kV line CKT 1, near KETCHTP4 (514828) 138 kV. a. Apply fault at the KETCHTP4 (514828) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9112-3PH	P1	3 Phase fault on PIEDMNT4 (514864) 138 kV to NORTWST4 (514879) 138 kV line CKT 1, near PIEDMNT4 (514864) 138 kV. a. Apply fault at the PIEDMNT4 (514864) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9113-3PH	P1	3 Phase fault on LNEOAK 4 (514873) 138 kV to NORTWST4 (514879) 138 kV line CKT 1, near LNEOAK 4 (514873) 138 kV. a. Apply fault at the LNEOAK 4 (514873) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.
FLT9114-3PH	P1	3 Phase fault on BRADEN 4 (514854) 138 kV to NORTWST4 (514879) 138 kV line CKT 1, near BRADEN 4 (514854) 138 kV. a. Apply fault at the BRADEN 4 (514854) 138 kV Bus. b. Clear fault after 7 cycles by tripping the faulted line. c. Wait 20 cycles, and then re-close the line in (b) back into the fault. d. Leave Fault on for 7 cycles, then trip the line in (b) and remove fault.

5.3 Scenario 1 Results

Table 5-4 shows the relevant results of the fault events simulated for each of the modified models in Scenario 1. Existing DISIS base case issues are documented separately in Appendix C. The associated stability plots are also provided in Appendix C.

Table 5-4: Scenario 1 Dynamic Stability Results (EGF = 0 MW, SGF = 210.56 MW)

Fault ID	25SP			25WP		
	Voltage Violation	Voltage Recovery	Stable	Voltage Violation	Voltage Recovery	Stable
FLT1000-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1001-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1002-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1003-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1004-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1005-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1006-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1007-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1008-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1009-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1010-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1011-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1012-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1013-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1014-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1015-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1016-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1017-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1018-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1019-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1020-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1021-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT9000-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9001-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9002-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9003-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9004-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9005-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9006-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9007-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9008-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9009-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9010-3PH	Pass	Pass	Stable	Pass	Pass	Stable

Table 5-4 continued

Fault ID	25SP			25WP		
	Voltage Violation	Voltage Recovery	Stable	Voltage Violation	Voltage Recovery	Stable
FLT9011-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9012-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9013-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9014-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9015-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9016-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9017-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9018-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9019-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9020-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9021-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9022-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9023-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9024-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9025-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9026-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9027-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9028-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9029-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9030-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9031-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9032-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9033-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9034-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9035-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9036-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9037-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9038-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9039-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9040-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9041-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9042-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9043-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9044-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9045-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9046-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9048-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9049-3PH	Pass	Pass	Stable	Pass	Pass	Stable

Table 5-4 continued

Fault ID	25SP			25WP		
	Voltage Violation	Voltage Recovery	Stable	Voltage Violation	Voltage Recovery	Stable
FLT9050-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9051-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9052-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9053-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9054-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9055-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9056-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9057-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9058-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9059-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9060-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9061-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9062-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9063-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9064-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9065-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9066-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9067-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9068-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9069-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9070-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9071-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9072-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9073-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9074-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9075-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9076-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9077-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9078-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9079-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9080-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9081-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9082-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9083-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9084-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9085-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9086-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9087-3PH	Pass	Pass	Stable	Pass	Pass	Stable

Table 5-4 continued

Fault ID	25SP			25WP		
	Voltage Violation	Voltage Recovery	Stable	Voltage Violation	Voltage Recovery	Stable
FLT9088-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9089-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9090-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9091-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9092-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9093-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9094-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9095-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9096-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9097-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9099-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9100-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9101-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9102-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9103-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9104-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9105-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9106-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9107-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9108-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9109-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9110-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9111-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9112-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9113-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9114-3PH	Pass	Pass	Stable	Pass	Pass	Stable

The results of the Scenario 1 dynamic stability showed several existing base case issues that were found in both the original DISIS-2021-001 model and the model with GEN-2025-SR30 included. These issues were not attributed to the GEN-2025-SR30 surplus request and detailed in Appendix C.

There were no damping or voltage recovery violations attributed to the GEN-2025-SR30 surplus request observed during the simulated faults. Additionally, the project was found to stay connected during the contingencies that were studied and, therefore, will meet the Low Voltage Ride Through (LVRT) requirements of FERC Order #661A.

5.4 Scenario 2 Results

Table 5-5 shows the relevant results of the fault events simulated for each of the modified models in Scenario 2. Existing DISIS base case issues are documented separately in Appendix C. The associated stability plots are also provided in Appendix C.

Table 5-5: Scenario 2 Dynamic Stability Results (EGF = 167.2 MW, SGF = 43.36 MW)

Fault ID	25SP			25WP		
	Voltage Violation	Voltage Recovery	Stable	Voltage Violation	Voltage Recovery	Stable
FLT1000-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1001-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1002-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1003-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1004-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1005-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1006-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1007-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1008-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1009-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1010-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1011-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1012-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1013-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1014-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1015-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1016-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1017-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1018-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1019-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1020-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT1021-SB	Pass	Pass	Stable	Pass	Pass	Stable
FLT9000-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9001-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9002-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9003-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9004-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9005-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9006-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9007-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9008-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9009-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9010-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9011-3PH	Pass	Pass	Stable	Pass	Pass	Stable

Table 5-5 continued

Fault ID	25SP			25WP		
	Voltage Violation	Voltage Recovery	Stable	Voltage Violation	Voltage Recovery	Stable
FLT9012-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9013-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9014-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9015-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9016-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9017-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9018-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9019-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9020-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9021-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9022-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9023-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9024-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9025-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9026-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9027-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9028-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9029-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9030-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9031-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9032-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9033-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9034-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9035-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9036-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9037-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9038-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9039-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9040-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9041-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9042-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9043-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9044-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9045-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9046-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9048-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9049-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9050-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9051-3PH	Pass	Pass	Stable	Pass	Pass	Stable

Table 5-5 continued

Fault ID	25SP			25WP		
	Voltage Violation	Voltage Recovery	Stable	Voltage Violation	Voltage Recovery	Stable
FLT9052-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9053-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9054-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9055-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9056-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9057-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9058-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9059-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9060-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9061-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9062-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9063-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9064-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9065-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9066-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9067-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9068-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9069-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9070-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9071-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9072-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9073-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9074-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9075-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9076-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9077-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9078-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9079-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9080-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9081-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9082-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9083-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9084-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9085-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9086-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9087-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9088-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9089-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9090-3PH	Pass	Pass	Stable	Pass	Pass	Stable

Table 5-5 continued

Fault ID	25SP			25WP		
	Voltage Violation	Voltage Recovery	Stable	Voltage Violation	Voltage Recovery	Stable
FLT9091-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9092-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9093-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9094-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9095-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9096-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9097-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9099-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9100-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9101-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9102-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9103-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9104-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9105-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9106-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9107-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9108-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9109-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9110-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9111-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9112-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9113-3PH	Pass	Pass	Stable	Pass	Pass	Stable
FLT9114-3PH	Pass	Pass	Stable	Pass	Pass	Stable

The results of the Scenario 2 dynamic stability showed several existing base case issues that were found in both the original DISIS-2021-001 model and the model with GEN-2025-SR30 included. These issues were not attributed to the GEN-2025-SR30 surplus request and detailed in Appendix C.

There were no damping or voltage recovery violations attributed to the GEN-2025-SR30 surplus request observed during the simulated faults. Additionally, the project was found to stay connected during the contingencies that were studied and, therefore, will meet the Low Voltage Ride Through (LVRT) requirements of FERC Order #661A.

6.0 Necessary Interconnection Facilities and Network Upgrades

This study identified the impact of the Surplus Interconnection Service on the transmission system reliability and any additional Interconnection Facilities or Network Upgrades necessary. The Surplus Interconnection Service is only available up to the amount that can be accommodated without requiring additional Network Upgrades unless (a) those additional Network Upgrades are either (1) located at the Point of Interconnection substation and at the same voltage level as the Generating Facility with an effective GIA, or (2) are System Protection Facilities; and (b) there are no material adverse impacts on the cost or timing of any Interconnection Requests pending at the time the Surplus Interconnection Service request is submitted.

6.1 Interconnection Facilities

This study did not identify any additional Interconnection Facilities required by the addition of the SGF.

6.2 Network Upgrades

This study did not identify any Network Upgrades required by the addition of the SGF. SPP will reach out to the TO and/or TOP to determine if there are any additional Network Upgrades that are either (1) located at the Point of Interconnection substation and at the same voltage level as the Generating Facility with an effective GIA, or (2) are System Protection Facilities.

7.0 Surplus Interconnection Service Determination and Requirements

In accordance with Attachment V of the SPP Tariff, SPP shall evaluate the request for Surplus Interconnection Service and inform the Interconnection Customer in writing of whether the Surplus Interconnection Service can be utilized without negatively impacting the reliability of the Transmission System and without any additional Network Upgrades necessary except those specified in the SPP Tariff.

7.1 Surplus Service Determination

SPP determined the request for Surplus Interconnection Service does not negatively impact the reliability of the Transmission System and no required Network Upgrades or Interconnection Facilities were identified by this Surplus Interconnection Service Impact Study performed by Aneden. Aneden evaluated the impact of the requested Surplus Interconnection Service on the prior study results and determined that the requested Surplus Interconnection Service resulted in similar dynamic stability and short circuit analyses and that the prior study steady-state results are not negatively impacted.

SPP has determined that GEN-2025-SR30 may utilize the requested 209 MW of Surplus Interconnection Service being made available by GEN-2007-021 & GEN-2014-002.

7.2 Surplus Service Requirements

The amount of Surplus Interconnection Service available to be used is limited by the amount of Interconnection Service granted to the existing interconnection customer at the same POI. The combined generation from both the SGF and the EGF may not exceed 209.43 MW at the POI, which is the total Interconnection Service amount currently granted to the EGF.

The customer must install monitoring and control equipment as needed to ensure that the SGF does not exceed the granted surplus amount and to ensure that combination of the SGF and EGF power injected at the POI does not exceed the Interconnection Service amount listed in the EGF's GIA. The monitoring and control scheme may be reviewed by the TO and documented in Appendix C of the SGF GIA.

SPP will reach out to the TO and/or TOP to determine if there are any additional Network Upgrades that are either (1) located at the Point of Interconnection substation and at the same voltage level as the Generating Facility with an effective GIA, or (2) are System Protection Facilities.